

REINHOLD ENVIRONMENTAL Ltd.



2012 NO_x-Combustion Round Table & Expo Presentation

February 13-14, 2012, in Columbus, OH / Hosted by AEP

All presentations posted on this website are copyrighted by Reinhold Environmental, Ltd (RE). Any unauthorized downloading, attempts to modify or to incorporate into other presentations, link to other websites, or obtain copies for any other uses than the training of attendees to RE's Conferences is expressly prohibited, unless approved in writing by RE or the original presenter. RE does not assume any liability for the accuracy or contents of any materials contained in this library which were presented and/or created by persons who were not employees of RE.



BabcockPower

Riley Power

Babcock Power, Inc.

ONE SOURCE · ONE PURPOSE · MANY SOLUTIONS



Combustion Optimization for
Maintaining Reduced Emissions on Wall
Fired Boilers

Reinhold Conference

Stephen Black

February 13, 2011



Riley Power

Combustion Optimization for
Maintaining Reduced Emissions on
Wall Fired Boilers

Reinhold Conference

Stephen Black

February 13, 2011




Training Program Overview

- Key Wall Fired Low NO_x Combustion Parameters
 - NO_x and Combustion Fundamentals
- Effects of the Mill, Burner, and Boiler System on Low NO_x Combustion
 - Design and Operation Considerations
 - Maintenance Considerations
- Re – Tuning of Combustion System for Low NO_x



Wall Fired Boilers

- Front Wall, Rear Wall or Opposed Fired
- Multi-level
- Vertical Columns of burners
- Key Design Factors
 - Furnace depth
 - Furnace height
 - Fuel Composition
 - Air & Coal Distribution

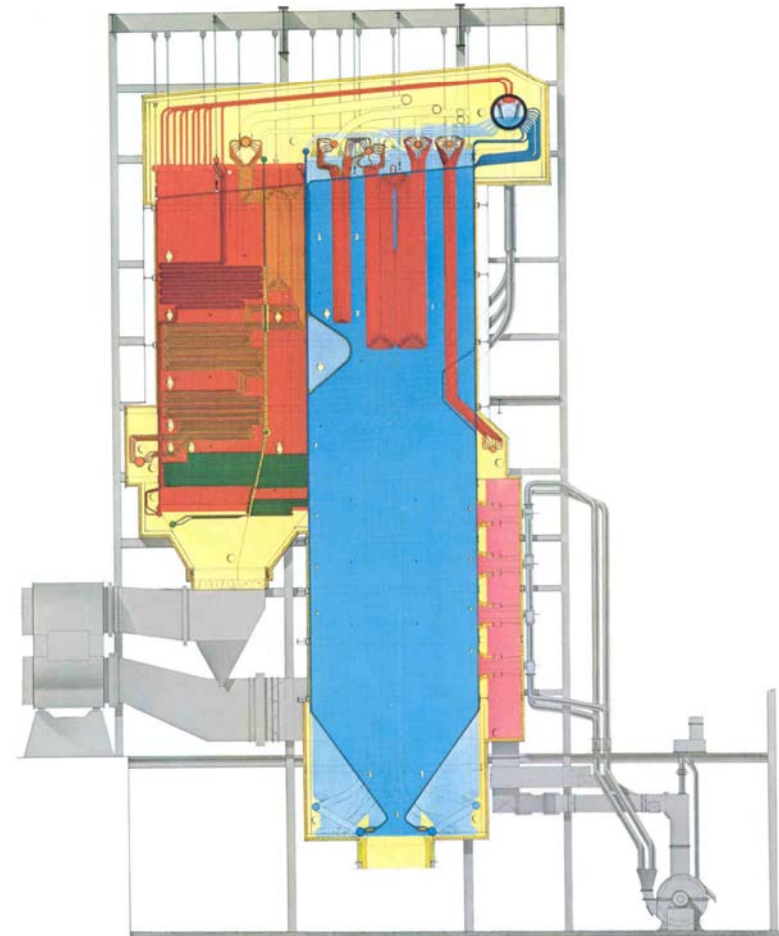

JEFFRIES STEAM PLANT
UNITS NO. 3 & 4



WFE Hugo 1 LNB Flames – PRB Coal During Startup





What are NO_x Emissions

- NO_x represents various “oxides of nitrogen”
 - Byproduct of combustion
 - Nitric Oxide, NO
 - Nitrogen Dioxide, NO₂
 - Stack Emissions Typically Over 95% NO
- Nitrogen resides in Air and Fuel
- Oxygen resides in Air and Fuel



Types of NO_x Production

- Thermal NO_x (~10% for coal)
 - Oxidation of the nitrogen in combustion air
 - Extremely sensitive to temperature
 - $N_2 + O \rightleftharpoons NO + N$
 - $N + O_2 \rightleftharpoons NO + O$
 - $N + OH \rightleftharpoons NO + H$
- Fuel NO_x (~90% for coal)
 - Produced from nitrogen in the fuel
 - N volatilizes off the surface of the coal particle as the particle heats
 - The N combines with available Oxygen in the same fashion as shown above




Combustion Fundamentals Effecting NO_x Formation

- 3 “T’s” of combustion
 - Temperature
 - Ignition Temperature
 - Peak flame temperature
 - Turbulence (*LNB’s reduce turbulence*)
 - Time (furnace geometry dependant)
 - Fuel type
 - Size of particles




Effects of Excess Air on Combustion

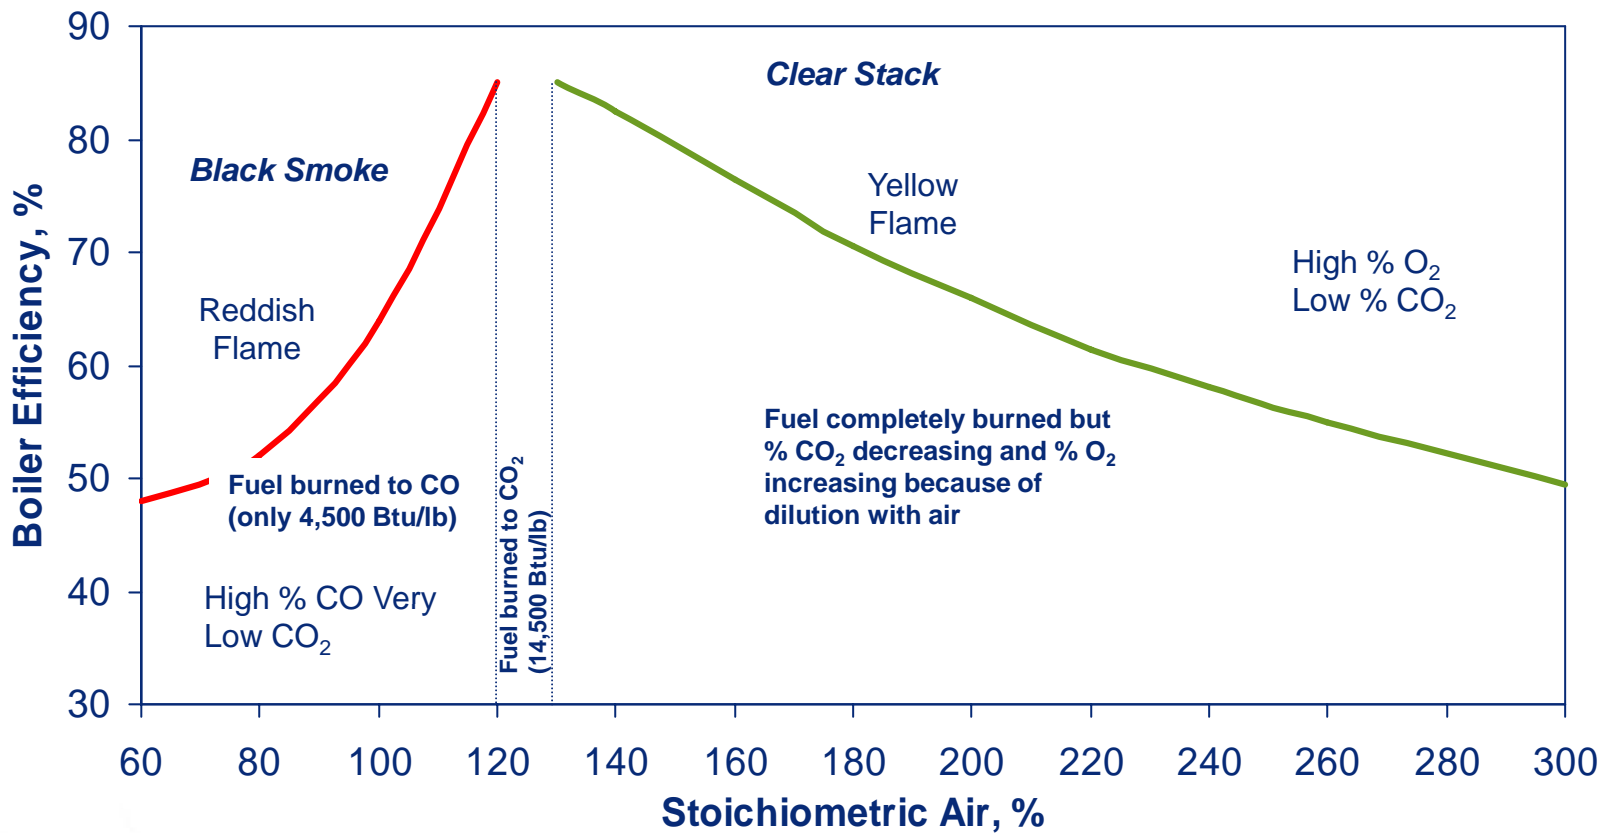




NO_x Emissions and UBC

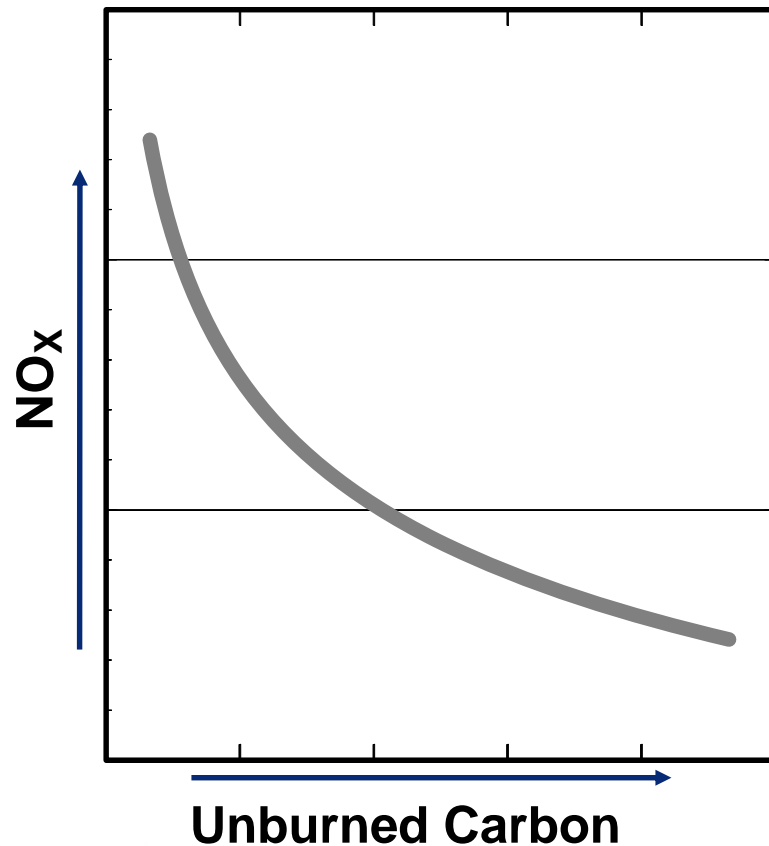

- Coal properties
 - Coal Rank
 - FC/VM Ratio
- Coal fineness
- Operating conditions
 - Excess O₂
 - Boiler load





NOx Emissions, CO, and Excess Air 235 MW boiler – bit. coal

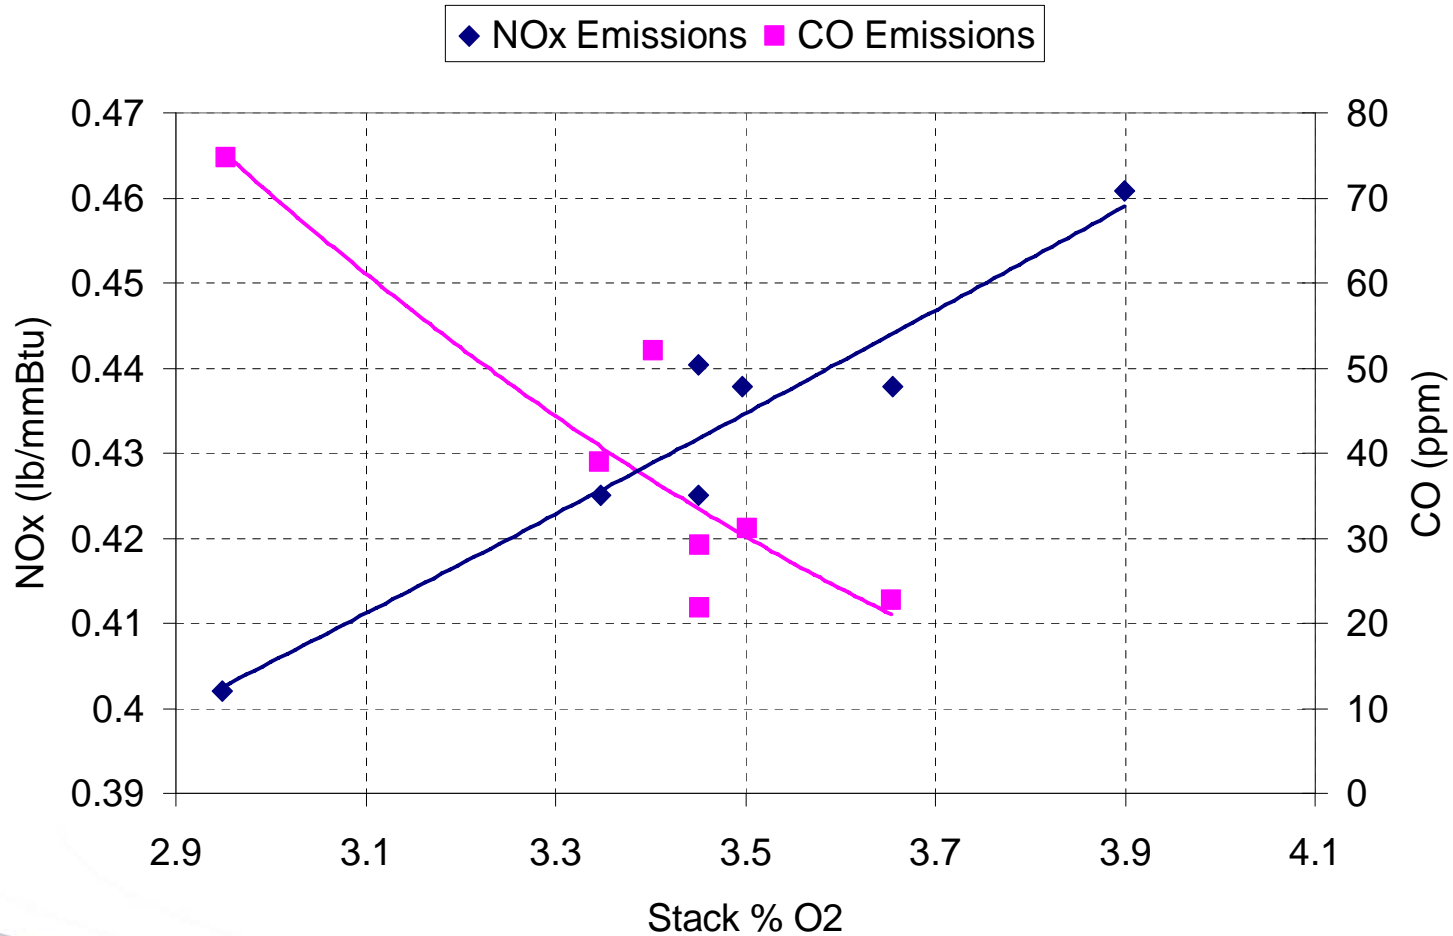




NO_x Control Strategies

- In Furnace (Combustion):
 - Modifications to the fuel and air delivery systems which reduce or eliminate the conditions that lead to the formation of NO_x during the combustion process
- Post Combustion Chemical Reagents:
 - Additional equipment downstream of the combustion process which chemically reduces NO_x to harmless Nitrogen (SCR).

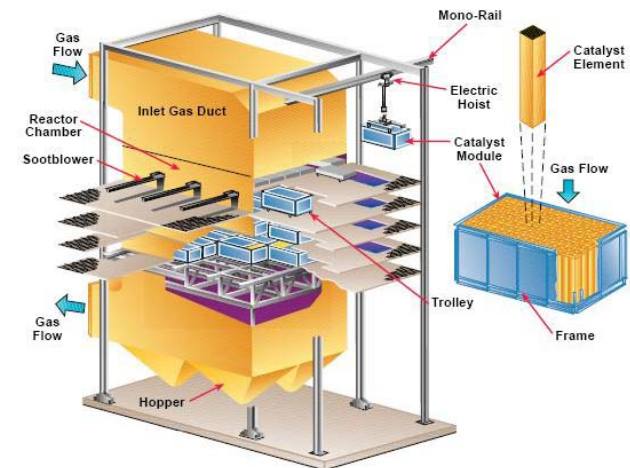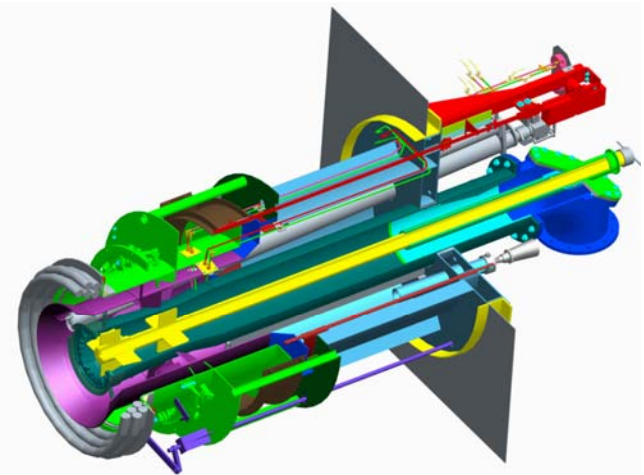




Controlling Combustion in Wall fired Units

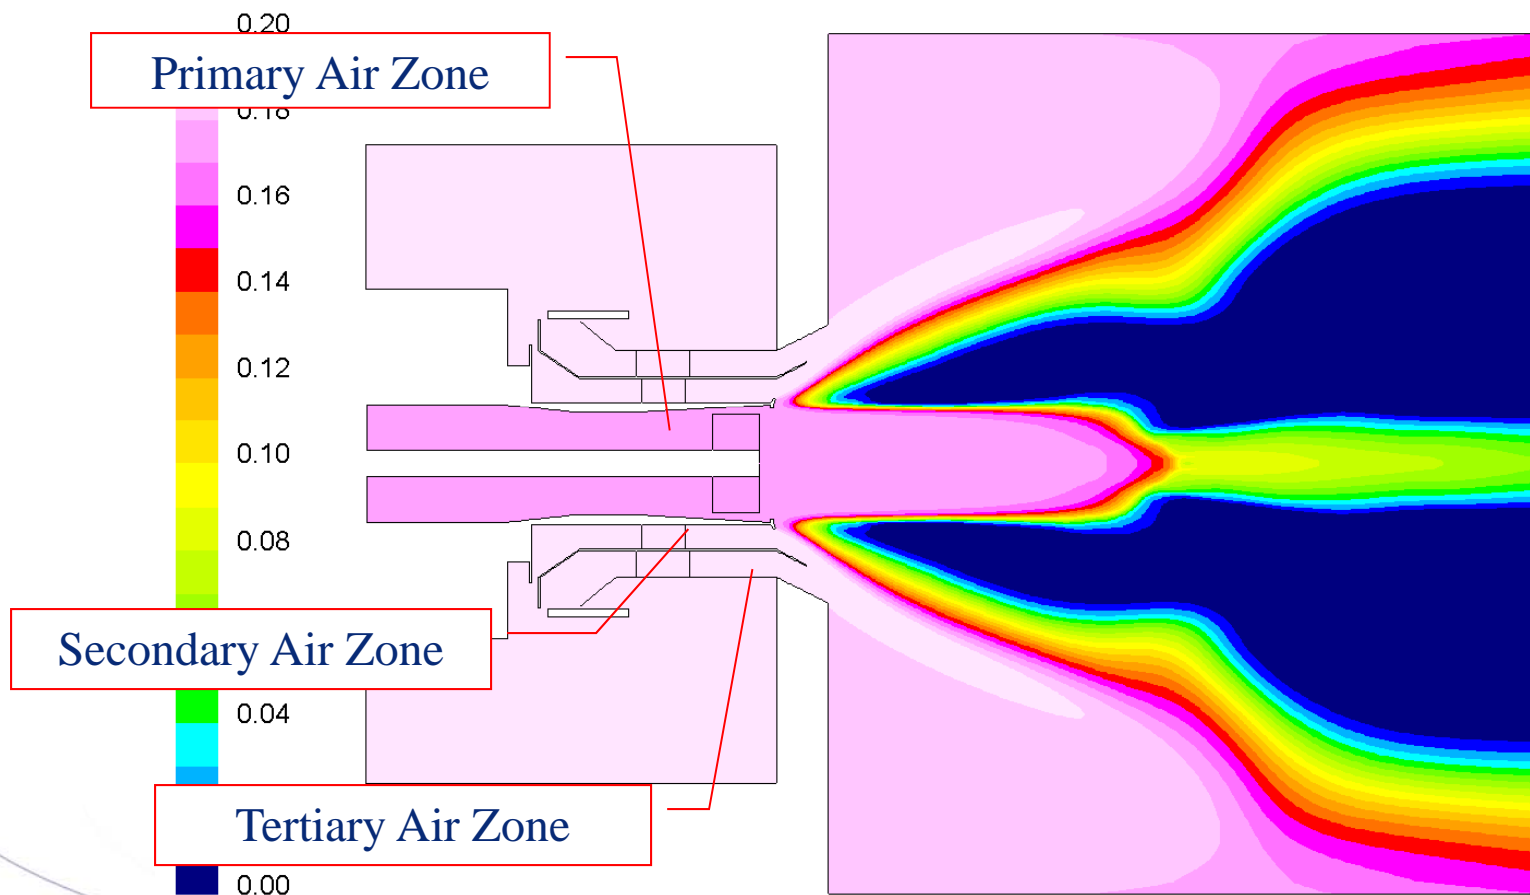



Low NOx Burner Design – Wall Fired

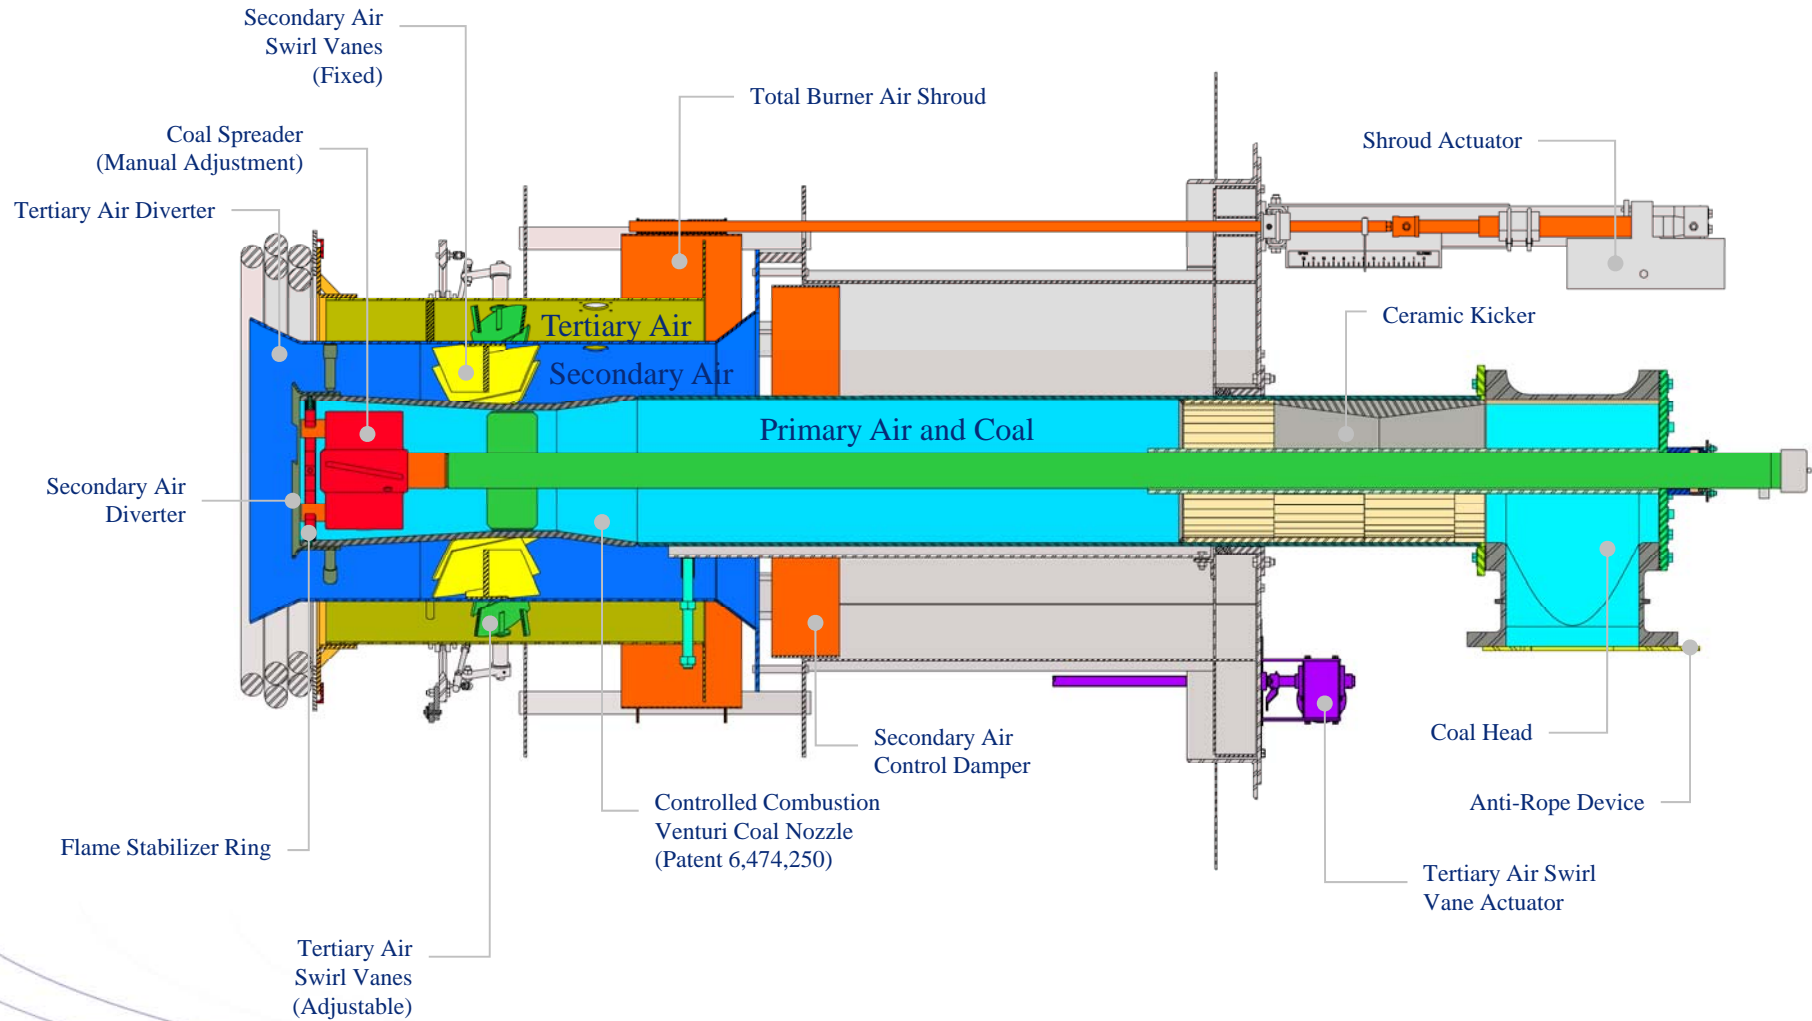



Wall Fired LNB Fabrication






LNB Installation 365 MW Boiler





Wall Fired OFA Arrangement – Front View

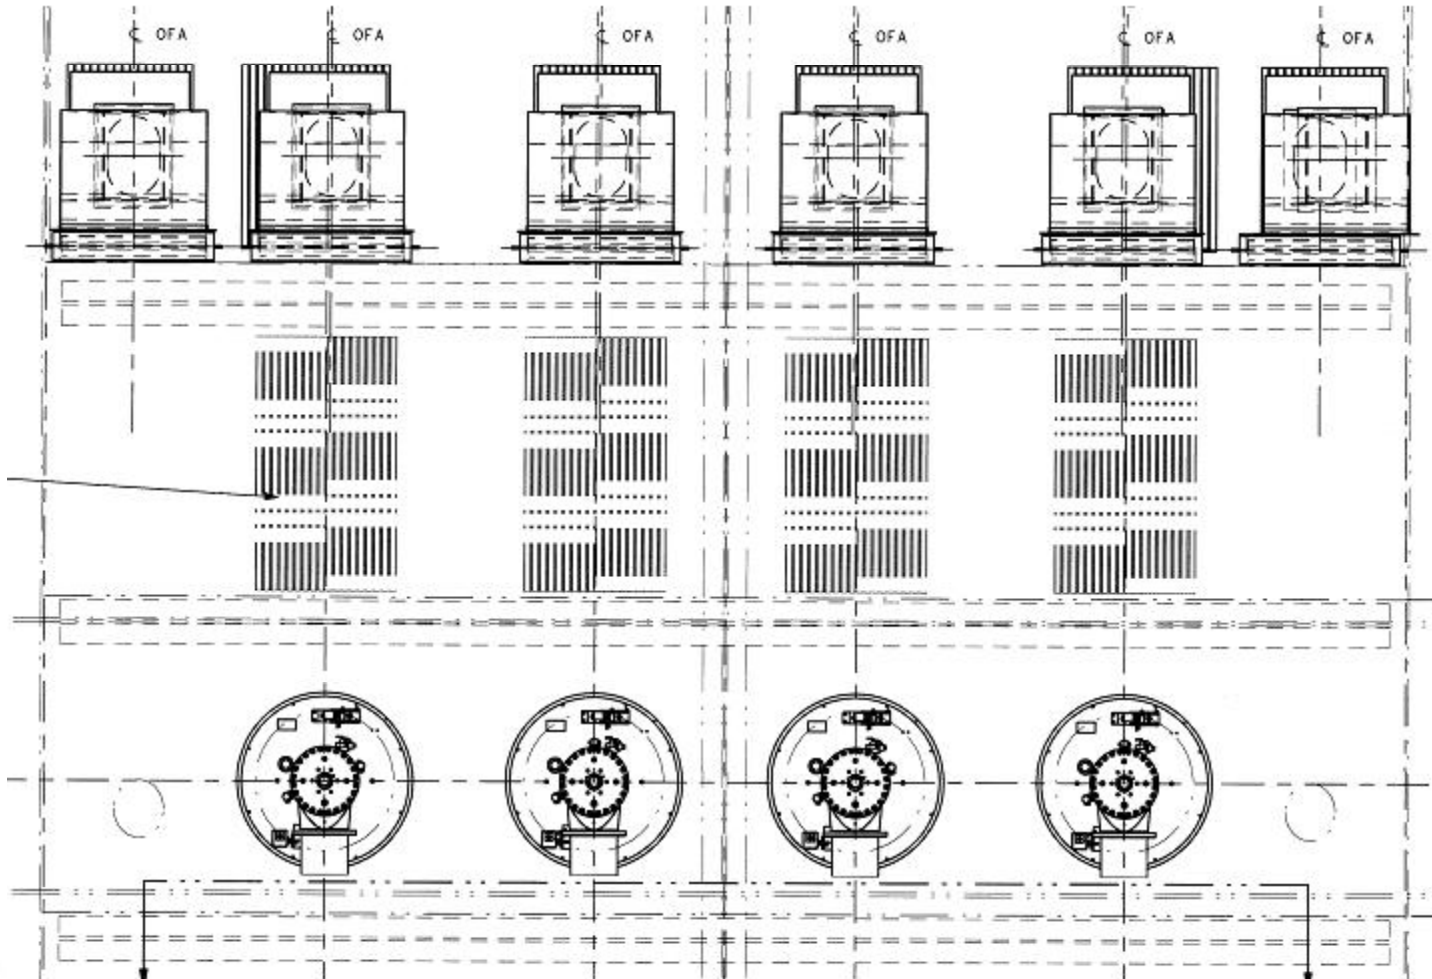



OFA Port Installation





Mill System Effects



Mill System – Key Parameters Effecting Low NO_x Combustion

- Primary Air (PA) Flow Balance to burners
- Coal Flow Balance to burners
- Coal Fineness
- Primary Air to Fuel Ratio
- Mills in or out of service
- Effects on CO and UBC are more pronounced than NO_x emissions



Importance of PA Flow Measurement in Mill System

- Implement proper PA flow characterization
- Integrated with LNB design
- Optimize the Primary Air / Coal Ratio throughout boiler load range
- Input for PA flow control
- Diagnosis for abnormal mill operation
 - Pluggage
 - burner line layout
 - erosion



Approaches of PA Flow Measurement

- Clean Air Basis
 - Coal pipe traverses with std. pitot probe and Mill Off Line
 - Primary Air Duct traverse with a s-type probe with the mill in operation
 - Airflow measuring devices such as Venturi, Pitot Array, ETC.
- Dirty Air Basis
 - Coal pipe traverses using dirty air probe with mill operating
 - On-line permanent/semi-permanent probe system
- LNB Requirements
 - Typically $\pm 15\%$ or less



Real Time PA Flow Measurement

- Clean air basis measurement in PA duct
 - Straightening device may be required to evenly profile airflow and temperature distribution
 - CFD modeling may be required to design and locate Straightening device for complex PA duct configurations
 - An array of probes with differential pressure lines separately manifolded for fully averaged and representative airflow sampling





Addressing Coal Flow Balance

- Characterize the system performance
- Determine the amount of imbalance present
- Utilize coal balancing devices with on-line adjustment
 - Variable orifices
 - Coal Flow distributors
 - Classifier Adjustments
 - Classifier Inlet or Outlet distribution devices
 - Dynamic Classifiers
- Re-Characterize the system balance



Coal Line Balancing Impacts on Emissions

- Pre NSPS burners could maintain good repeatable performance with variations of $\pm 20\%$
- LNB typically require a coal pipe-to-pipe distribution of $\pm 15\%$ or less
- To achieve the best possible combustion emissions less than $\pm 5\%$ deviation pipe-to-pipe coal flow is ideal


Coal Feeder Balance

- Typically mill to mill coal flows should be maintained within $\pm 5\%$



Coal Fineness Basics

- Rosin-Rambler Plots
- Minimum fineness requirement
 - 98% passing 50 mesh
 - 70% passing 200 mesh
- Average Mill Fineness versus Coal Pipe fineness
- One coal pipe with poor fineness can have an effect on emissions

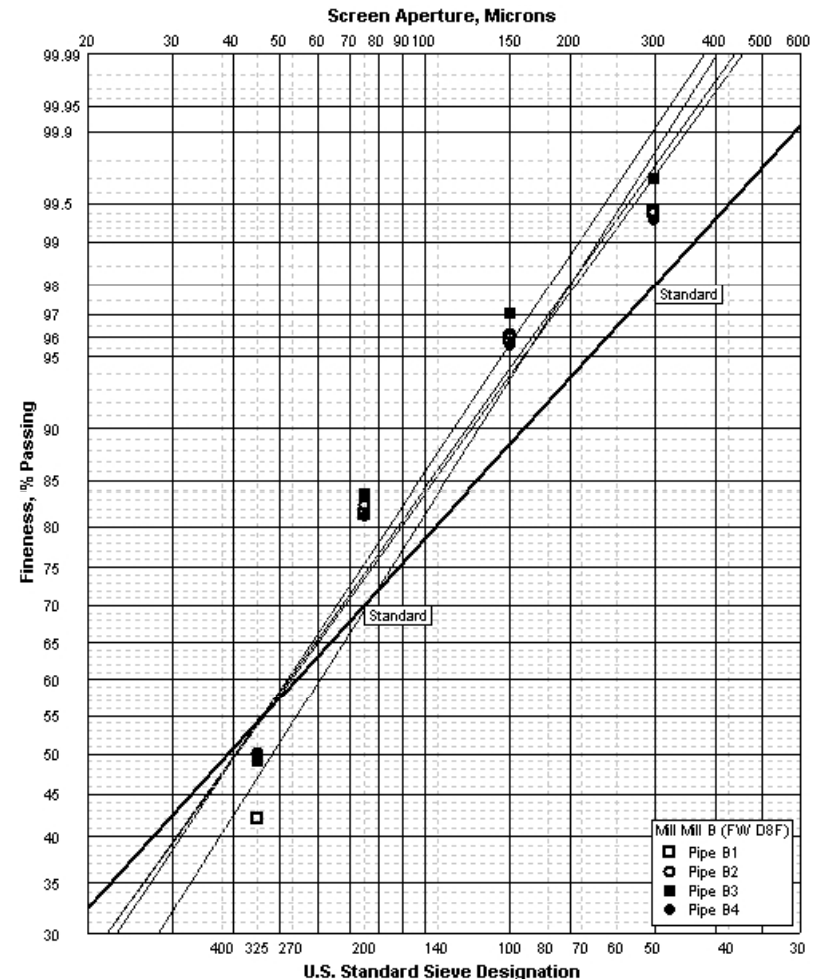





Coal Fineness for Low NOx

- Maintaining the coal fineness over time is critical
- Coal particle size distribution directly effects emissions (more bit. Coal than PRB)



Effect of coal fineness on NO_x and Unburned Carbon

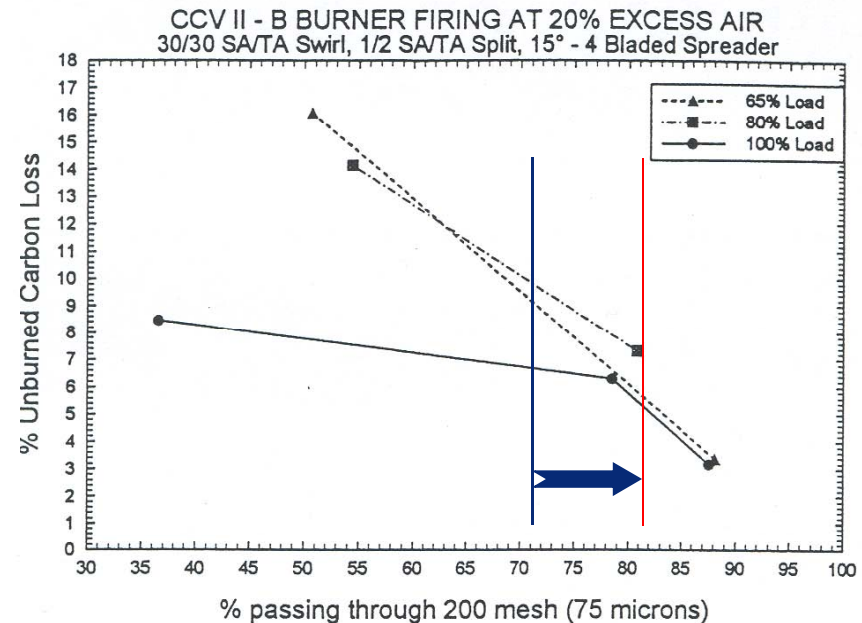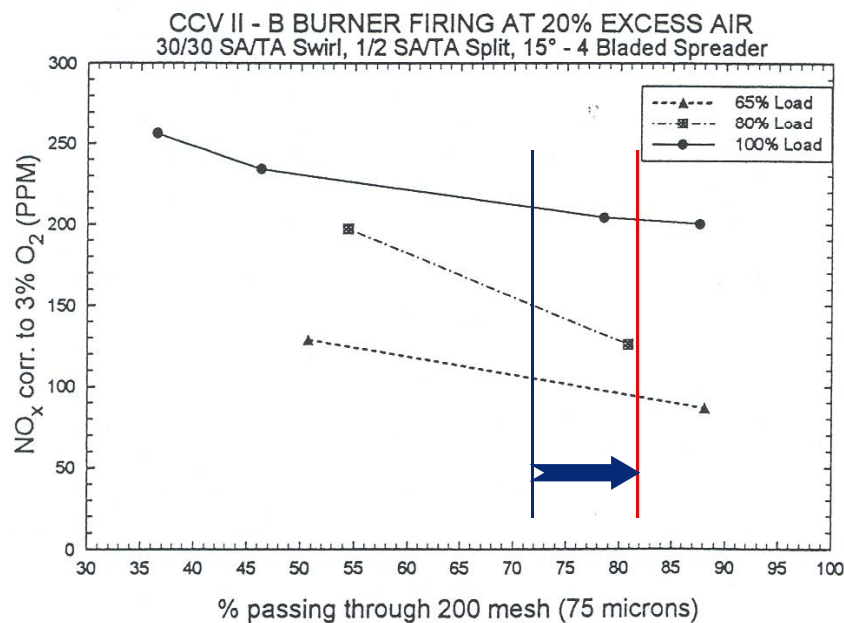

**Laboratory Data @ 100 MBtu/hr
1996 Test Facility Data**



Mill Maintenance Basics

- Establish a list of critical inspection points within the mill system which effect the performance of the mill
- Inspect the mills during each outage
- Use inspections to track the dimensions/wear to forecast future repair and replacement requirements



Example List for Ball Tube Mill System

Component	Original Dimension /Setting	Year 2	Year 4	Minimum Before Replacement
Mill Liner Profile Depth	3.25" peak to peak	3.0" peak to peak	2.7" peak to peak	1.75" Peak to Peak
PA Flow Pitot	100,000 KPPH \pm 5,000	100,000 KPPH \pm 6,000	100,000 KPPH \pm 6,000	\pm 10,000 Recalibrate or Replace probe
Classifier Vane Length x Width	6" x 9"	5.5" x 8"	5" x 7"	75% of the length or 50% of the Width
Classifier Inverted Cone	24" @ Base x 18" H x 1/4" th	23.25" x 17.75" x 3/16"	23" x 17" x 1/8" with one hole	No holes

- Vertical Roller Mill – Critical wear components are the rollers and nozzle ring
- Atrita Pulverizers – Critical wear components are the Hammers, Pegs, Clips & rejector arms



Low NO_x Burner Effects



Combustion & Low NO_x Burners

- Burner reduces formation of NO_x by:
 - Lowering peak flame temperatures
 - Controlling amount of O₂ in combustion zone (i.e. mixing)
 - PA/ SA/ TA flow splits
 - Swirl/ turbulence
- Results in a longer and extended flame pattern
- Burner must control fuel and air flow and air flow must be controllable and balanced burner to burner



Challenges of Low NO_x Burner Design

- Compatibility with existing mill operation and limitations
- Wide range of fuel properties – utilities purchase coal on spot market
- Fit within existing furnace geometry with minimal respacing or pressure part reconfiguration
- Minimizing UBC & CO while optimizing NO_x performance
- Operation up to four or more years between major outages




Erosion Factors for Coal Burners

- Fuel ash chemistry
- Ash percentage by weight
- Velocity
 - In the coal pipe
 - Through the Primary side of the burner
- Ash Concentration in the secondary air stream



Coal Abrasiveness

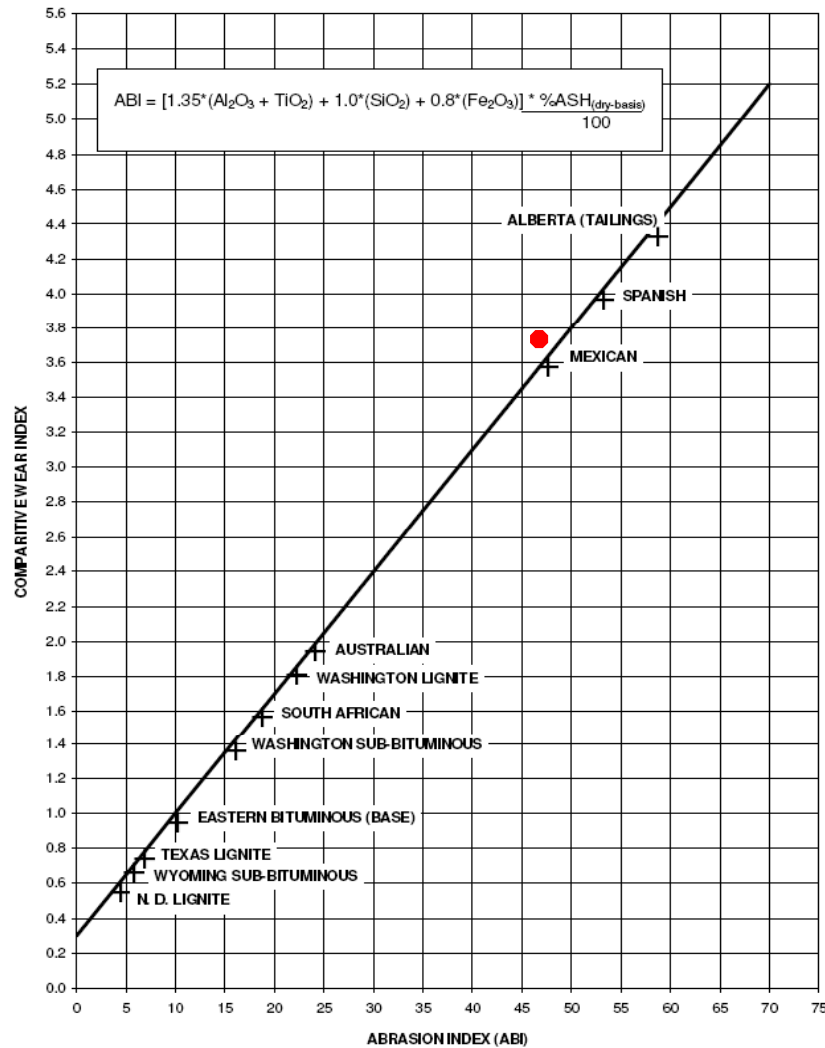

ABRASIVE INDEX CALCULATION

$$ABI = (1.35(Al_2O_3 + TiO_2) + 1.0(SiO_2) + 0.8(Fe_2O_3)) \cdot (\% ash_{(dry-basis)} / 100)$$

coal type	Indian Coal 1	Indian Coal 2
% ash _(as-received)	43	43.5
% moisture	12	12
% ash _(dry-basis)	48.9	49.4
Al ₂ O ₃ wt%	27.36	27.36
TiO ₂ wt%	1.84	1.84
SiO ₂ wt%	61.85	61.85
Fe ₂ O ₃ wt%	5.18	5.18
ABI	51.5	52.1




Advanced Material Selection for Critical LNB Components

- Maintain the geometry of key LNB components, results in:
 - Increase in time before degradation in burner performance
 - Reduced maintenance outage requirements
 - Reduced spare parts inventory requirements



**Mass Lost
15 Degree Test Angle**

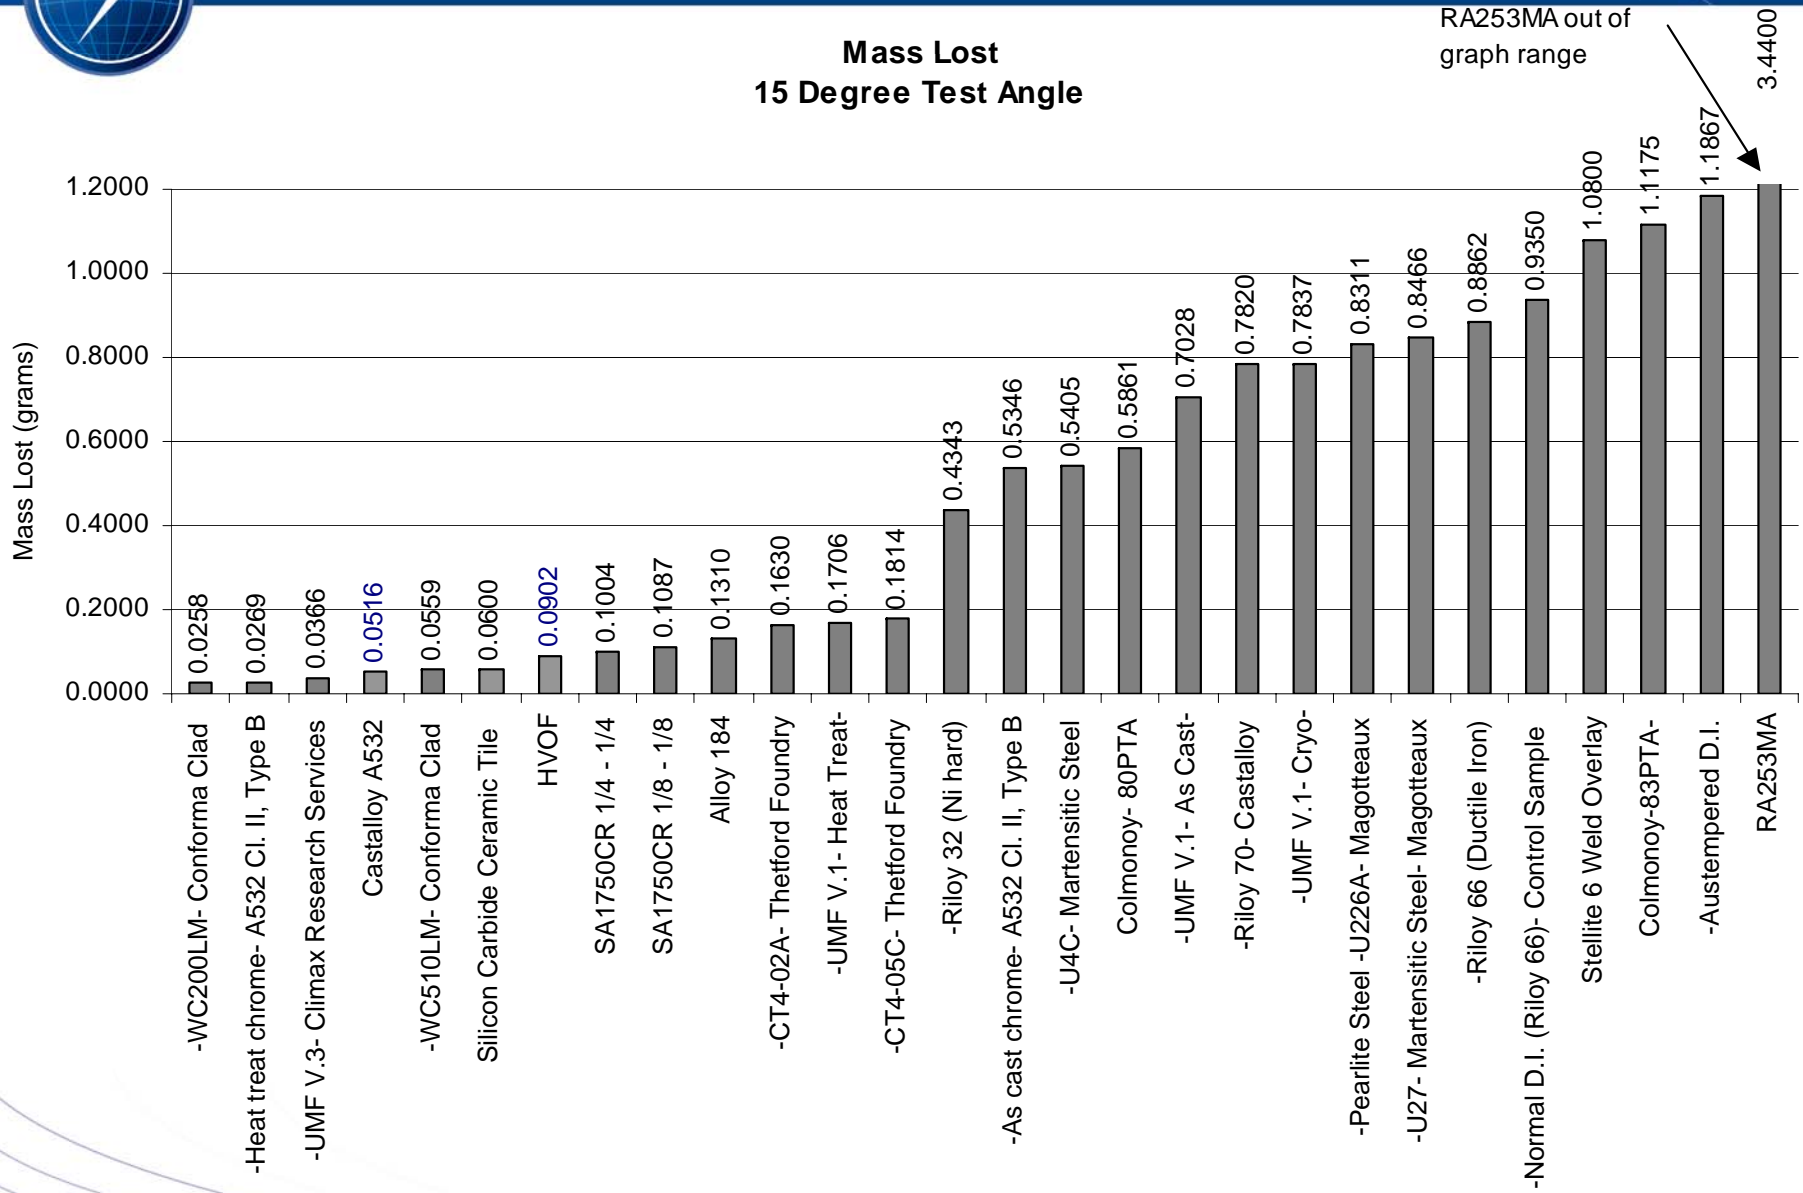



Establishing Primary Side Burner Component Life as a Function of ABI

Component	Low Cost Material ABI < 15	Estimated Wear Life (Years)	Upgraded Materials ABI < 15	Estimated Wear Life (Years)
Coal Head	Carbon Steel	3	CS with Ceramics	> 8
Protective Liner	Hardened Steel	> 2	CS with Ceramics	> 8
Bluff Body in Coal Nozzle*	Carbon Steel Stainless Steel	> 2	CS or SS with Tungsten Cladding	> 8
Coal Nozzle Tip/Body	Stainless Steel	3	SS with Tungsten Cladding	> 7
Straightening/Distributor	Carbon Steel	> 2	Hardened Plate	> 4

* Base material is dependent on the location of the body and the local out of Service temperature




Establish Replacement / Repair Criteria for Critical Primary Side LNB Components

<u>Component</u>	<u>Repair/Replacement Criteria</u>
Bluff Body Component	>50% (in) ^{Note 2 typ} Loss of original length
Nozzle Tip	≥1/2 inch of increase in internal diameter
Ceramic Tiles	≥50% (in) loss of thickness and no missing or detached tiles ^{NOTE 1}
Protective Lining Tiles	≥50% (in) loss of thickness and no missing or detached tiles ^{NOTE 1}
Coal Head Lining Tile	Detached tiles ^{NOTE 1}



Flame Stabilizer Ring & Coal Spreader

3 Years in Service w/ Tungsten Carbide Cladding

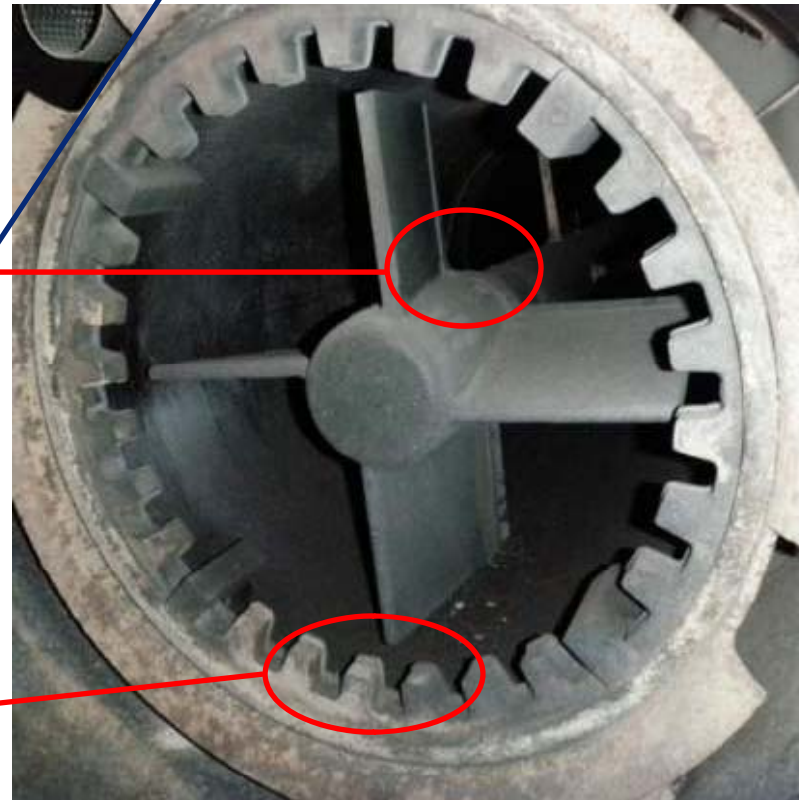



Maintaining Functionality of the Air Register of the LNB

- The operating functions of the Air Register are important to maintaining good low NO_x emissions
 - Controls the airflow balance from burner to burner
 - Directs the secondary air entering the furnace and mixing (spin/swirl) with the coal.
 - Controls the total secondary air to the burner
 - Controls the w/f dP
- Swirl vanes need to be functional to support optimization for significant fuel variations over time
- Air modulation control is important to ensuring local burner zone stoichiometry can be controlled



Example Air Register Fully Functional After 3 Years in Service





Effects of Boiler System Conditions



Effects of Heat Absorption on Low NO_x Combustion

- Low heat absorption in the burner zone increases the local temperature and raises NO_x
- Low heat absorption in the radiant pendants increases fouling potential which can affect emissions
- Use of wallblowers and sootblowers are important to maintaining the furnace conditions for controlling peak temperatures - especially on PRB coal firing



Effects of Operation Parameters on Low NO_x Combustion

- Airflow Balance
 - Good Airflow balance starting with FD Fans
 - Results in Flue Gas temperature balance
 - Results in Economizer Exit O₂ balance
- Minimize Air Leakage for O₂ readings
 - Accurate O₂ readings result in accurate airflows
- Steady control of furnace pressure
 - Results in steady burner airflow and combustion



Effects of Operation Parameters (Con.'t)

- Parameters effecting fuel firing rates
 - Coal quality can effect the feed rate
 - Low economizer inlet water temperature can increase the firing rate
 - Consistent coal feed to the mill can effect the firing rate and unit fluctuations



Re – Tuning of Low NOx Burners



Detailed Planned Approach

- Understand the goals of the testing
 - Is lowest NOx emissions the goal?
 - Is lower UBC or CO emissions the goal?
 - Is furnace conditioning the goal?
- Prioritize the goals for success
- Schedule req'd. unit loads for testing
- Schedule testing times but be aware of potential delays



Detailed Planned Approach (con.'t)

- A Test Matrix with a logical progression of tests designed to achieve the goals of the testing.
- Emissions sampling location and grid equipment
 - Portable analyzers versus a test truck
 - Test time versus cost



Example of Low NOx Test Plan & Matrix

Test #	Unit Load)	Windbox Dampers (°closed)	Swirl Vane (°)	BRN Air Balnce	% O ₂ wet	OFA Damper Bias	Flame Length Adj	Data and Samples Required ⁽¹⁾
1	MCR	As Found	20	As Found	3.1	100/100	1	BR, B, FO, G
2		Bias per ⁽²⁾ 2.1						BR, B, FO, G
3								BR, B, FO, G
4								BR, B, FO, G
5								BR, B, FO, G
6		30						
7		35						
8		OPT	40	Bias per 2.3			BR, B, FO, G	
9					2.7		BR, B, FO, G	
10					2.6		BR, B, FO, G	
13				OPT		Balance	BR, B, FO, G	
14				OPT			2.5 ⁽³⁾	BR, B, FO, G
15					OPT	4	BR, B, FO, G	
16	INT					OPT	ALL	
17	LOW						ALL	



Boiler Operation/Tuning for Low NOx

- Reduce the amount of excess air to the furnace as much as possible to achieve lowest NOx while maintaining low CO and % UBC.
- Windbox to Furnace Differential Pressure should be optimized according to furnace and burner type and fuel being fired (~4.0 – 4.5" W/F dP seems best)
- Coal flow distribution to the furnace should be balanced to $\pm 15\%$, PA distribution to $\pm 10\%$.
- Balance air distribution to burners



Optimization Strategies

- Primary Airflow Balance
 - Mill testing to determine the current airflow balance and identify any deficiencies
 - Install balancing devices as required to correct the airflow within +/- 10%
 - Confirm balance with testing on the mill
 - Good primary airflow balance can help minimize CO while achieving low NOx emissions



Optimization Strategies

- Coal Flow Balance
 - Coal flow out of the mill should be within +/- 15% of the mean on a weight basis
 - Correcting pipe to pipe balance can be difficult
 - Coal particle sizes is important to achieving low LOI/UBC
 - Coal distribution within the burner nozzle



Optimization Strategies

- Secondary Airflow Balance
 - SA balance begins at the FD Fan
 - Varying approaches can be utilized to improve the balance entering the burner
 - Divided windbox versus common windbox designs
 - Individual burner air balancing
 - Airflow measurement devices for assisting with balancing
 - CFD modeling of windbox and upstream ductwork
 - Economizer outlet grid O₂ measurement
 - Good Air distribution improves furnace conditions, decreases CO and NOx emissions and lowers UBC



Optimization Strategies

- Overfire Airflow Balance
 - Overfire Air system designs vary, but have some similarities
 - From the Windbox
 - From the Main Secondary Air Feed
 - From Booster Fans
 - Balance from port – to – port improves overall furnace distribution
 - biasing may be required depending on the furnace conditions
 - CFD modeling of the WB & Furnace for distribution and mixing
 - Balancing the low NO_x Burners first with OFA closed can better isolate the OFA tuning.



Test Support and Personnel

- Plant participation is critical to ensure success
 - Operational assistance and involvement improves the effectiveness of the tuning process
 - Test coordination for unit load conditions and sample procurement
 - Availability of key personnel to assist with system controls, settings and issues can reduce the optimization time required
- The OEM of the low NOx equipment must have trained well seasoned service personnel to conduct the optimization
 - Knowledge of total boiler & fuel systems operation is an asset
 - Knowledge of the equipment and tuning process is essential



Test Support and Personnel

- Third Party Test Teams
 - Utilizing a test company with a mobile gas sampling system can shorten the test duration by decreasing the gas sample collection time.
 - Utilizing a test crew for mill testing can minimize the time required to review and reset the mill characterization curve.
 - Cost is a concern when deciding to use any test company.
 - If the plant has the personnel available and trained then testing at the economizer outlet grid and for the mill can be completed without a 3rd party test company.



Summary

- Maintain mill system at or near design conditions (PA & Coal Distribution, fineness, A/C)
- Maintain the low NO_x burner on both the primary and secondary sides to ensure reliable long term performance
- Characterize and operate the boiler within the known design ranges whenever possible



Summary

- If re-tuning is needed, a well defined plan improves the process of optimization / tuning
- Low NOx burners are one part of the combustion system. Optimizing the mill and boiler system is also part of a good tuning strategy.
- Air and Fuel Balancing is key to any low NOx burner optimization program.
- Documentation of the optimization testing is critical to reducing test time for any future testing.



BabcockPower

Riley Power

THANK YOU !



BabcockPower
ENVIRONMENTAL

bpi**green**[™]



BabcockPower
SERVICES



BabcockPower
EUROPE s.r.o.



RILEYPower
A Babcock Power Inc. Company

VoigtPower
International

A Babcock Power Inc. Company



TEI CONSTRUCTION SERVICES, INC.
A Babcock Power Inc. Company

TEI

A Babcock Power Inc. Company



Welding Technologies
A Division of Babcock Power Services Inc.



CLADDING TECHNOLOGIES
A Division of Babcock Power Services Inc.

TEI
Struthers
SERVICES



Boiler Tube Company of America
A Babcock Power Inc. Company