

REINHOLD ENVIRONMENTAL Ltd.



2010 APC Round Table & Expo Presentation

July 18-20, 2010, in Concord, NC / Hosted by Duke Energy

All presentations posted on this website are copyrighted by Reinhold Environmental, Ltd (RE). Any unauthorized downloading, attempts to modify or to incorporate into other presentations, link to other websites, or obtain copies for any other uses than the training of attendees to RE's Conferences is expressly prohibited, unless approved in writing by RE or the original presenter. RE does not assume any liability for the accuracy or contents of any materials contained in this library which were presented and/or created by persons who were not employees of RE.



Corrosion/Erosion Of FGD Components

Gordon Maller – URS Corporation

URS

2010 APC/PCUG Conference

Workshop Outline

- **Basics of Corrosion**
- Corrosion History of Scrubbers
- Guidelines for Scrubbers
- Material Selection: Corrosion and erosion issues and guidelines
 - Alloys
 - FRP
 - Other materials

Corrosion Basics


- Definition – Corrosion is defined as a dissolution of a material due to reactions with the surrounding environment
 - For FGD, the surrounding environment can be harsh
- Almost anything can corrode:
 - Glass
 - Plastics
 - Ceramics
 - Steels and steel alloys
 - Other Metals

8 Forms of Corrosion


- General corrosion
- Galvanic corrosion
- Intergranular corrosion
- *Pitting & crevice*
- *Stress corrosion cracking*
- Erosion corrosion
- Selective leaching

Basic Mechanism for Pitting



- Occurs in metals that require presence of passive film for corrosion protection
- Requires simultaneous presence of oxidizing agent and chloride ion
- Occurs at location of damage (scratches), embedded iron or sulphide inclusion

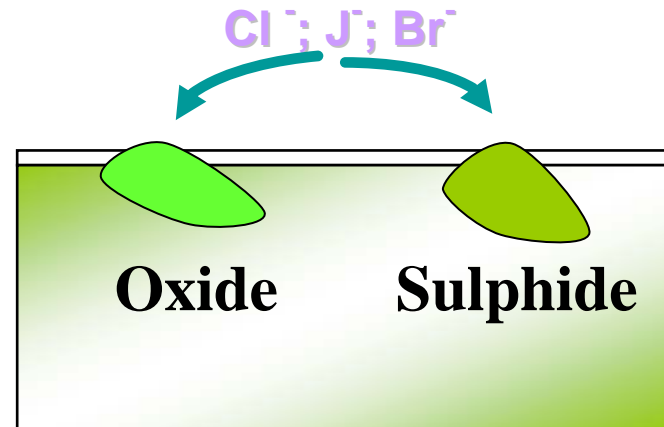

Damage Appearance

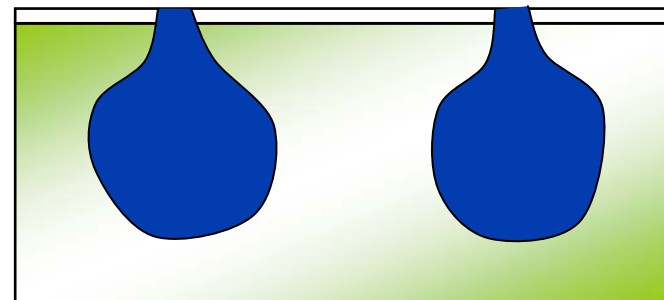


Examples of Pitting Corrosion

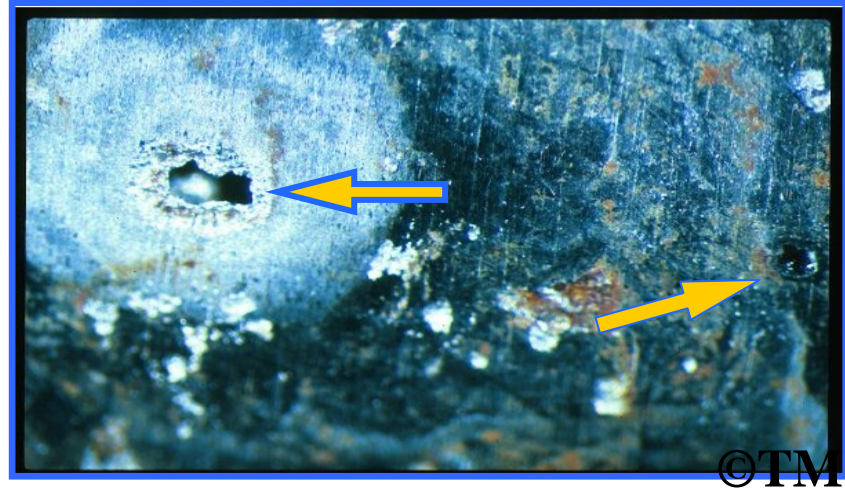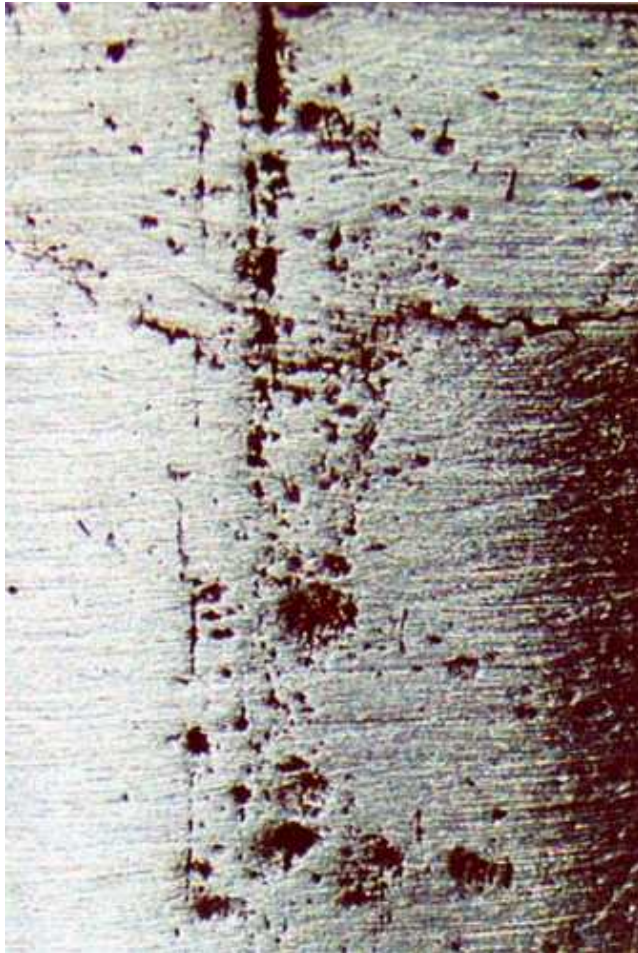

Mechanism for Crevice Corrosion



- Result of formation of an oxygen concentration cell on the surface of an otherwise passive metal (e.g., SS)
- Crevice can be created by metal-to-metal contact (e.g., bolt head), or nonmetal-to-metal contact (e.g., gasket)
- The tighter the crevice the more severe the corrosion

Examples of Crevice Corrosion

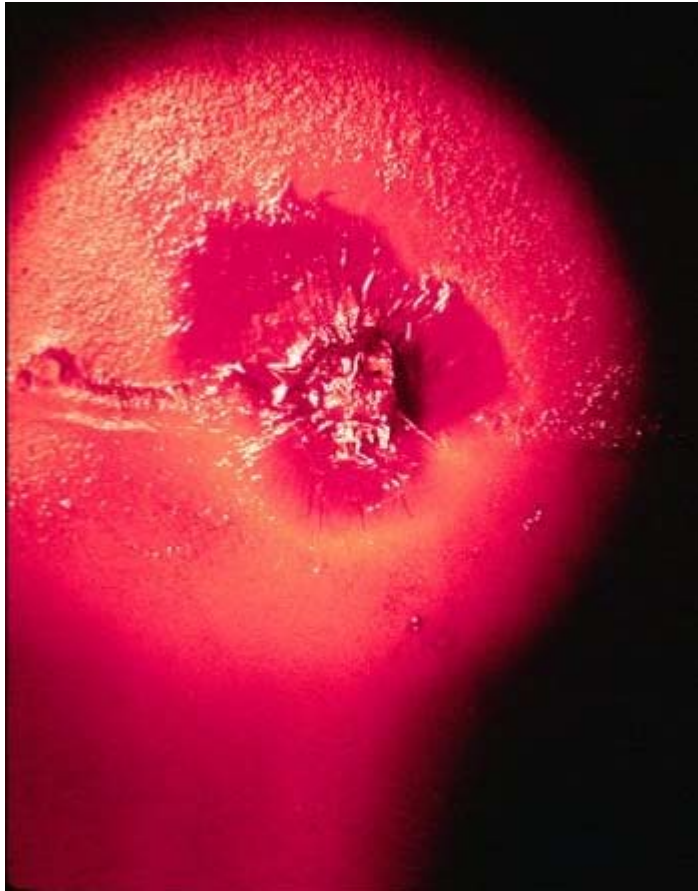


Stress Corrosion Cracking

- Responsible for most corrosion related catastrophic failures
- Requires presence of tensile stress:
 - Residual welding stresses
 - Forming stresses
 - Operating stresses
 - Frictional stresses
- In general austenitic SS more susceptible

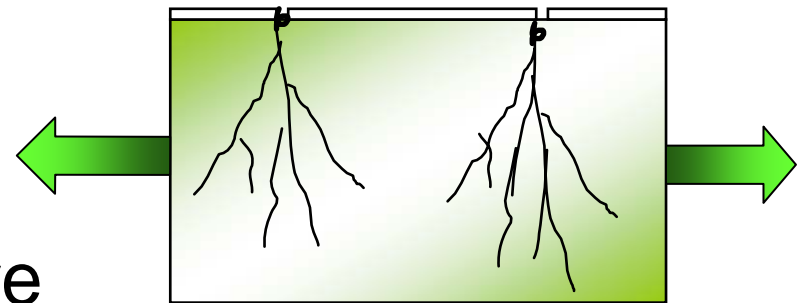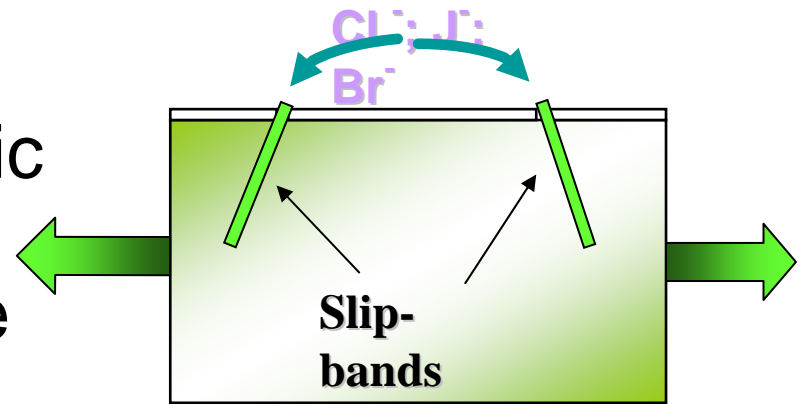

**Damage appearance:
irregular and branched**

Stress Corrosion Cracking

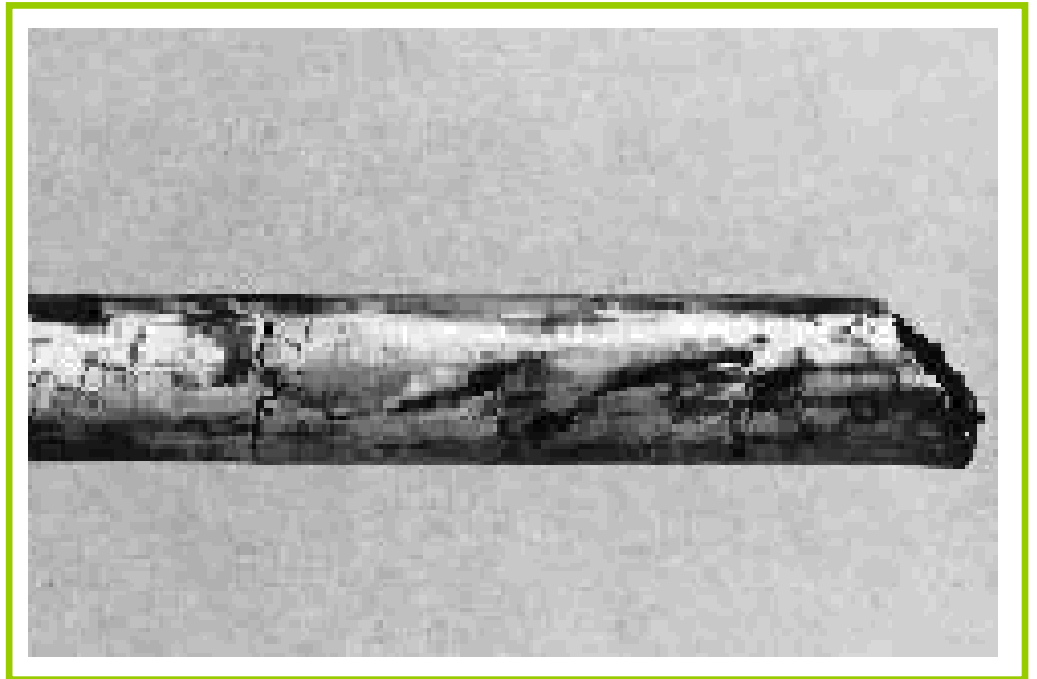

Workshop Outline

- Basics of Corrosion 101
- Corrosion History of Scrubbers
- Guidelines for Scrubbers
- Material Selection:
 - Alloys
 - FRP
 - Other materials

Early History

- First generation scrubbers ('70s and '80s):
 - General underestimation of corrosion severity.
 - Carbon steel or carbon steel lined with non-metallic coating common
 - Many failures occurred especially in outlet ducts due to acidic condensate
 - Repairs made by new applications of non-metallic coating, or lower Mo containing alloys
 - Significant development effort for improved non-metallic coatings
 - Lower Mo containing alloys experienced high failure rate due to pitting/crevice corrosion

Wallpaper Concept

- First used at R.D. Morrow in early '80s
- Thin (typically 1.6 mm) sheets of high Ni-Cr-Mo alloy applied over carbon steel to provide the needed corrosion resistance
- Original alloy used was C-276

Second Generation Scrubbers

- Wide spread use of “wallpapering” and “cladding” of alloy liners
 - Wallpapering refers to attaching thin sheets (typically 1.6mm) of an alloy liner to a metal substrate, typically CS. The sheets are cut to fit and skip or seal-welded to the substrate. Subsequent sheets overlap the first sheet and are seal-welded to prevent leaks
 - Cladding refers to bonding of a corrosion resistant alloy plate to a CS backing plate. The alloy is either hot-roll or explosion bonded to the backing plate. Typical thicknesses are 1.6mm for the alloy plate and 4.8mm for the CS plate

Second Generation Scrubbers (continued)

- Other materials used include:
 - Rubber lined carbon steel (RLCS);
 - Lined carbon steel (LCS):
 - Flaked glass
 - Organic-based and epoxy resins
 - Foamed borosilicate glass block;
 - Ceramic tile;
 - Fiberglass reinforced plastic (FRP)

Current Design Trends

- No spare absorber
- 100% of flue gas is scrubbed
- No reheat
- High reliability requirements
- Many system operated to produce wallboard-grade gypsum. As a result, chloride levels run much higher
- Widespread use of alloy, FRP and ceramic tile for construction materials

Workshop Outline

- Basics of Corrosion 101
- Corrosion History of Scrubbers
- **Guidelines for Scrubbers**
- Material Selection:
 - Alloys
 - FRP
 - Other materials

Factors Influencing Corrosion in Scrubber

- Sulfur content of flue gas
 - Will affect acidity of condensate
- Temperature
- pH
- Chloride
- Fluoride (?)
- Solid deposits can lead to localized corrosion attacks by concentrating chlorides and by providing oxygen-deprived crevice conditions.
- Corrosion and erosion often go hand-in-hand.

Guidelines for Scrubber Zones

Zone	Description	Factors	Preferred Materials
Gas Inlet Duct	Inlet duct upstream of where moisture forms	Hot (250 to 330 F) dry gas	Unlined CS
Inlet Quench Zone	Absorber inlet at point where gas first contacts slurry	Fluctuating temperature. Wet/dry interface. Potential for solid deposits.	Alloys Ceramic tile
Reaction Tank and Slurry Piping	Includes reaction tank and slurry piping	Temperature well modulated. Potential for erosion Potential for scale growth Floors subject to mechanical damage pH typically 5 to 6 but low pH excursion possible Chlorides range site specific	Alloys Ceramic tile FRP RLCS LCS

Guidelines for Scrubber Zones (continued)

Zone	Description	Factors	Preferred Materials
Absorber and Spray Zone	Area from inlet to absorber downstream of quench to inlet of mist eliminator	Moderate temperature which are well modulated pH typically 3.5 to 5.5 Erosion may be a problem Scaling may be a problem	Alloys Ceramic tile FRP RLCS LCS
Absorber Outlet Duct, Wet	Extends from outlet of absorber to either stack breaching or beginning of reheat zone	Wet, saturated gas, Acidic (pH 1 to 2) condensate on walls and floor, Solid deposits possible	Alloys Ceramic tile FRP RLCS LCS Foamed borosilicate glass block

Guidelines for Scrubber Zones (continued)

Zone	Description	Factors	Preferred Materials
Absorber Outlet Duct With Reheat	Outlet duct from reheater to stack breaching	Reheat rarely achieves complete dryness due to short residence time, Tends to concentrate aggressive ions due to evaporation of water film, Acidic condensate less likely, Temperature range 140 to 190 F	Alloys Ceramic tile LCS Foamed borosilicate glass block
Absorber Outlet Duct With Bypass Reheat	Extends from treated and bypass gas mixing zone to stack breaching	Extremely aggressive corrosion zone due to highly acidic condensate High temperature areas possible due to thermal gradients	High Ni alloys (e.g., C276) Ceramic tile Foamed borosilicate glass block

Guidelines for Scrubber Zones (continued)

Zone	Description	Factors	Preferred Materials
Stack	Stack breaching to discharge	<p>Without reheat gas will be wet and saturated</p> <p>Acidic condensate likely on walls. Condensate will need to be collected.</p> <p>With reheat, thermal gradients possible resulting in conditions which range from wet to dry</p>	<p>Acid brick</p> <p>Alloys</p> <p>FRP (wet stack)</p> <p>LCS</p> <p>Foamed borosilicate glass block</p> <p>CS (if gas is dry)</p>
Reagent and Storage Tanks	Interiors of tanks and associated piping	<p>Ambient or near ambient temperature</p> <p>pH range from slightly acidic to alkaline</p> <p>Chloride level will determine corrosivity</p>	<p>Alloys</p> <p>Ceramic tile</p> <p>FRP</p> <p>RLCS</p> <p>LCS</p> <p>CS</p>

Workshop Outline

- Basics of Corrosion 101
- Corrosion History of Scrubbers
- Guidelines for Scrubbers
- **Material Selection:**
 - Alloys
 - FRP
 - Other materials

Characteristics of Alloys

- Corrosion resistance results from formation of thin passive surface-oxide film. Common for alloys containing at least 12% Cr
- Pitting Resistance Equivalent Number (PREN) used to rank pitting and generally corrosion resistance of alloys

$$\text{PREN} = \%Cr + 3.3*\%Mo + 1.65*\%W + 16*\%N$$

- Corrosion resistance improves with increasing Cr, Ni, Mo, and N content
 - Cr provides passive surface film
 - Mo and N improve resistance to pitting and crevice corrosion
 - Ni improves fabrication and weldability and also assists in renewing damaged passive surface film

Composition and PREN Values For FGD Alloys

Trademark	UNS	C	Cr	Ni	Mo	N	Others	PREN
316L	S31603	< 0.030	17	11	2.0	0.02	-	24.5
316LM	S31653	< 0.030	18	15	4	0.06		32
317LMN	S31703	< 0.030	18	14	4.2	0.15	-	33
2205	S31803	< 0.030	21.0 23.0	4.5 6.5	2.5 3.5	0.08 0.20	-	34
2205	S32205	< 0.030	22.6	6	3.3	0.18	-	36
904L	N08904	< 0.020	20	25	4.3	0.13	Cu = 1.5	37
255/2507	S32520	< 0.030	25	7	3.5	0.25	Cu = 1.5	41
6Mo	N08926	< 0.020	20	25	6.2	0.2	Cu = 1	43
C625	N06625	< 0.020	22	61	9	-		51
C276	N10276	< 0.020	16	56	16	-	T=3.5	75

Alloy Selection Guide

		Temp: 130°F - 150°F							
		Mild	Moderate		Severe		Very Severe		
Chlorides:		500	1,000	5,000	10,000	30,000	50,000	100,000	200,000
Mild	pH - 6.5	Type 316L SS	Type 317LMN or 22% Cr Duplex SS		25% Cr Super Duplex SS		6% Moly Superaustenitic SS	Nickel Alloy 625 etc. (9% Mo)	Nickel Alloy C276 etc.. (13/16% Mo)
Moderate	pH - 4.5	Type 317LMN or 22% Cr Duplex SS	22% Cr Duplex SS		25% Cr Super Duplex SS		6% Moly Superaustenitic SS		
Severe	pH - 2.0	Type 317LM SS	22% Cr Duplex SS		25% Cr Super Duplex SS		6% Moly Superaustenitic SS		
Very Severe	pH - 1.0	Type 317LMN SS	6% Moly Superaustenitic SS		25% Cr Super Duplex SS		Nickel Alloy 625 etc. (9% Mo)		

Source: NiDI

Mechanical and Hardness Properties of Alloys

- Higher hardness results in better abrasion resistance
- Duplex Stainless Steels have roughly twice the yield strength of their counterpart austenitic grades
- This allows equipment designers to use thinner gauge material for construction

Grade	Hardness (BHN)
304L	215
316L	217
317L	217
317LMN	223
904L	220
6Mo	240
2304	290
2205	293
255	302
2507	310

Alloy Summary

- Proper selection of alloy critical for good performance
- Good strength and mechanical properties. Able to span absorber without intermediate supports allowing self-supporting spray headers
- Good fabrication characteristics
- Duplex SS exhibit better hardness and mechanical properties than corresponding austenitic grades

Fiberglass Reinforced Plastics (FRP)

- Have been used for many applications:
 - Process piping
 - Internal recycle spray systems
 - Ductwork
 - Stack liners
 - Storage tanks
 - Absorbers (JBR)
- FRP is a composite material which is built by layering different materials (resins, glass fibers) to achieve required properties
- Vacuum Infusion Panels


Application of FRP Materials

- Process piping needs to include abrasion resistant liner (ARL) at least 0.1" thick. Internal spray headers need liner on both inside and outside
- FRP thermally expands at a different rate than steel. FRP is also inherently inflexible. As a result, detailed pipe stress analysis should be performed to verify design and placement of supports



Vacuum Infusion Technology

The Fusion of Composites and Technology

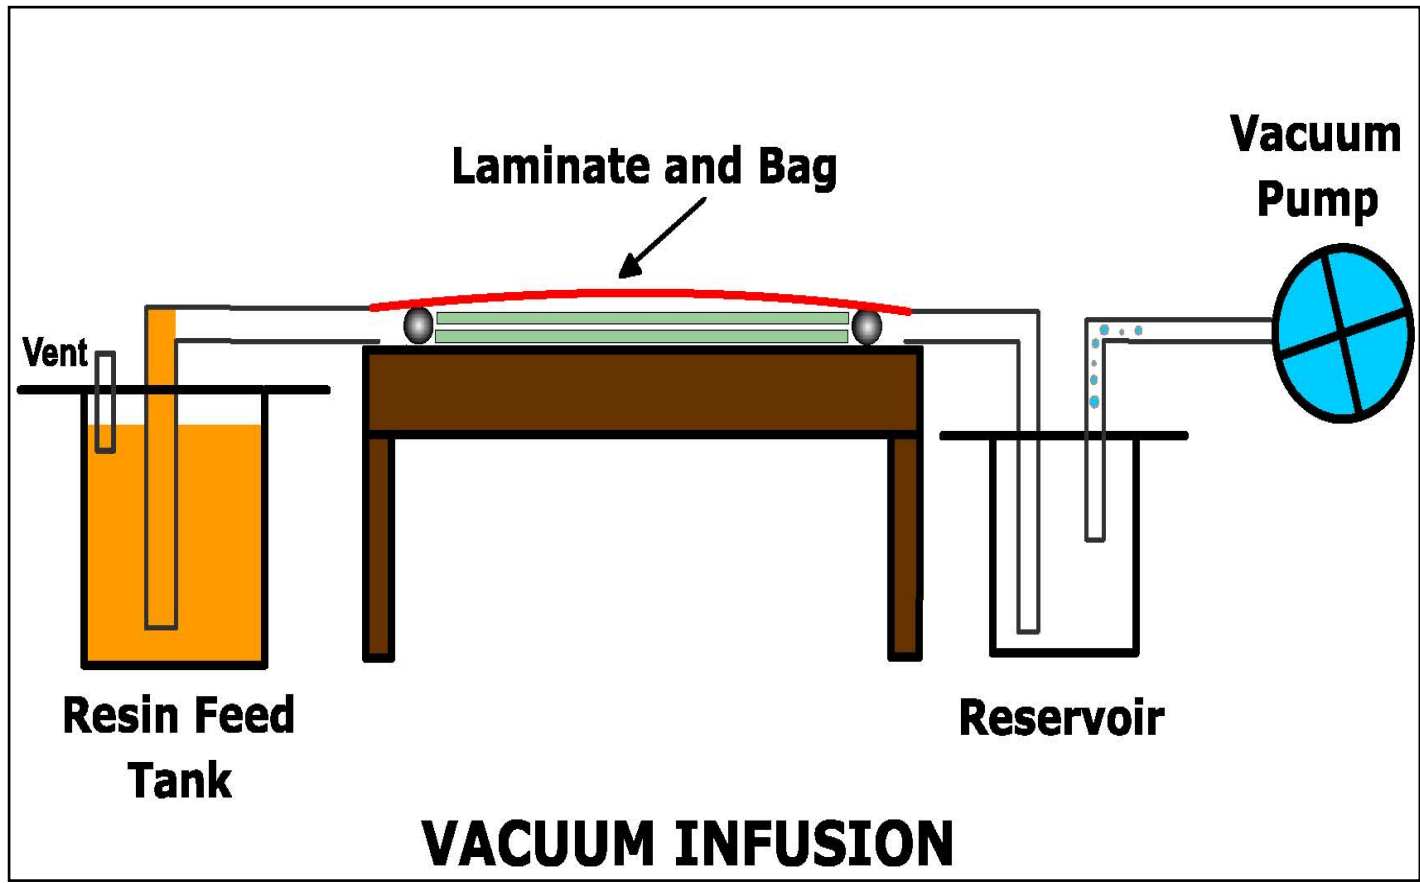

VIP Capabilities

NMR VIP™ The Fusion of Composites and Technology



- Large flat panel manufacturing
- Customized corrosion, abrasion, and ballistic applications

NMR VIP™ The Fusion of Composites and Technology

FGD Scrubber Applications:

Inlet Duct-Rectangular
Internal Decks
Outlet Duct
Scrubber Floors
Scrubber Roofs



FRP Summary

- FRP materials (piping, tanks, equipment) have been used successfully in FGD service for many years
- Provide good corrosion resistance
- Piping does not have structural strength of alloy
- Inherently inflexible, easily damaged if stressed (e.g., pipe hammer)
- Lower cost than alloy
- Failures usually result of improper material selection, bad design, or faulty installation



Other Materials

- Stebbins tile lining
- Stebbins tile/concrete
- RLCS
 - Prone to cold wall effects and water permeation
 - Correct application in controlled environment is critical to success
- LCS
 - Includes organic-based and epoxy resins, and flake-glass
 - Correct application in controlled environment critical
 - Susceptible to mechanical damage

