

Worldwide Pollution Control Association

Gulf Power Coal to Gas Seminar
May 30-31, 2012

All presentations posted on this website are copyrighted by the Worldwide Pollution Control Association (WPCA). Any unauthorized downloading, attempts to modify or to incorporate into other presentations, link to other websites, or to obtain copies for any other purposes than the training of attendees to WPCA Conferences is expressly prohibited, unless approved in writing by the WPCA or the original presenter. The WPCA does not assume any liability for the accuracy or contents of any materials contained in this library which were presented and/or created by persons who were not employees of the WPCA.



Visit our website at www.wpca.info

W
P
C
A



thebabcock&wilcoxcompany

Gas Conversion Projects Burner Management Considerations

Pensacola, Florida – May 30, 2012

Detroit, Michigan – June 5, 2012

John E. Bollinger
Manager – IC & E Engineering


Key Topics

1. NFPA
2. Main Gas Supply
3. Igniter Gas Header
4. Main Gas Header
5. Venting
6. Flame Scanning
7. Combustion Control



National Fire Protection Association

Within the Boiler House – NFPA 85

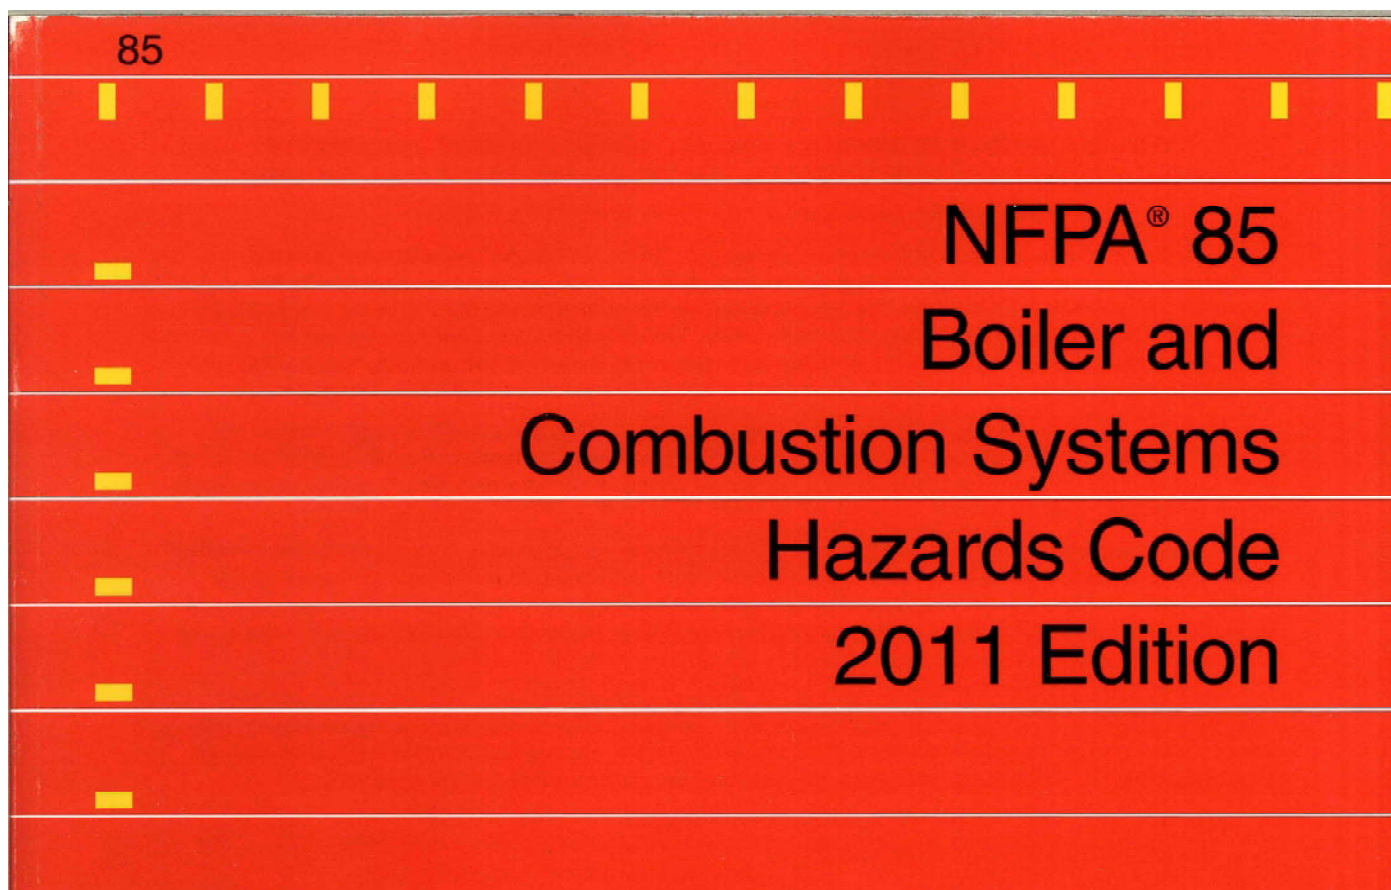


NFPA – Balance of Plant


1. Natural Gas Supply – NFPA 54 National Fuel Gas Code
2. Liquefied Natural Gas – NFPA 59A - Standard for the Production, Storage, and Handling of Liquefied Natural Gas. (LNG)

Potential use as a replacement for oil as an igniter fuel.

Main Gas Supply

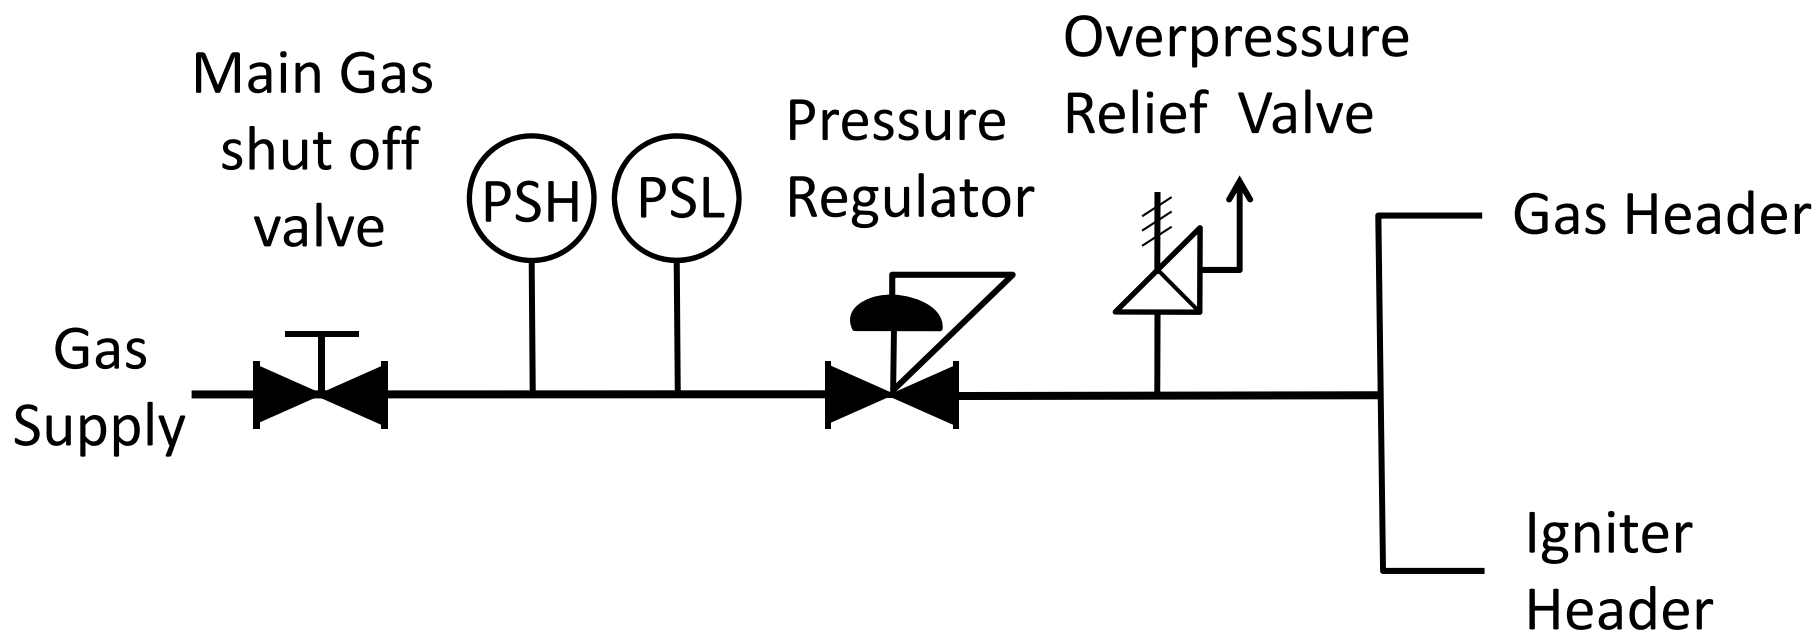


Igniter Gas Header

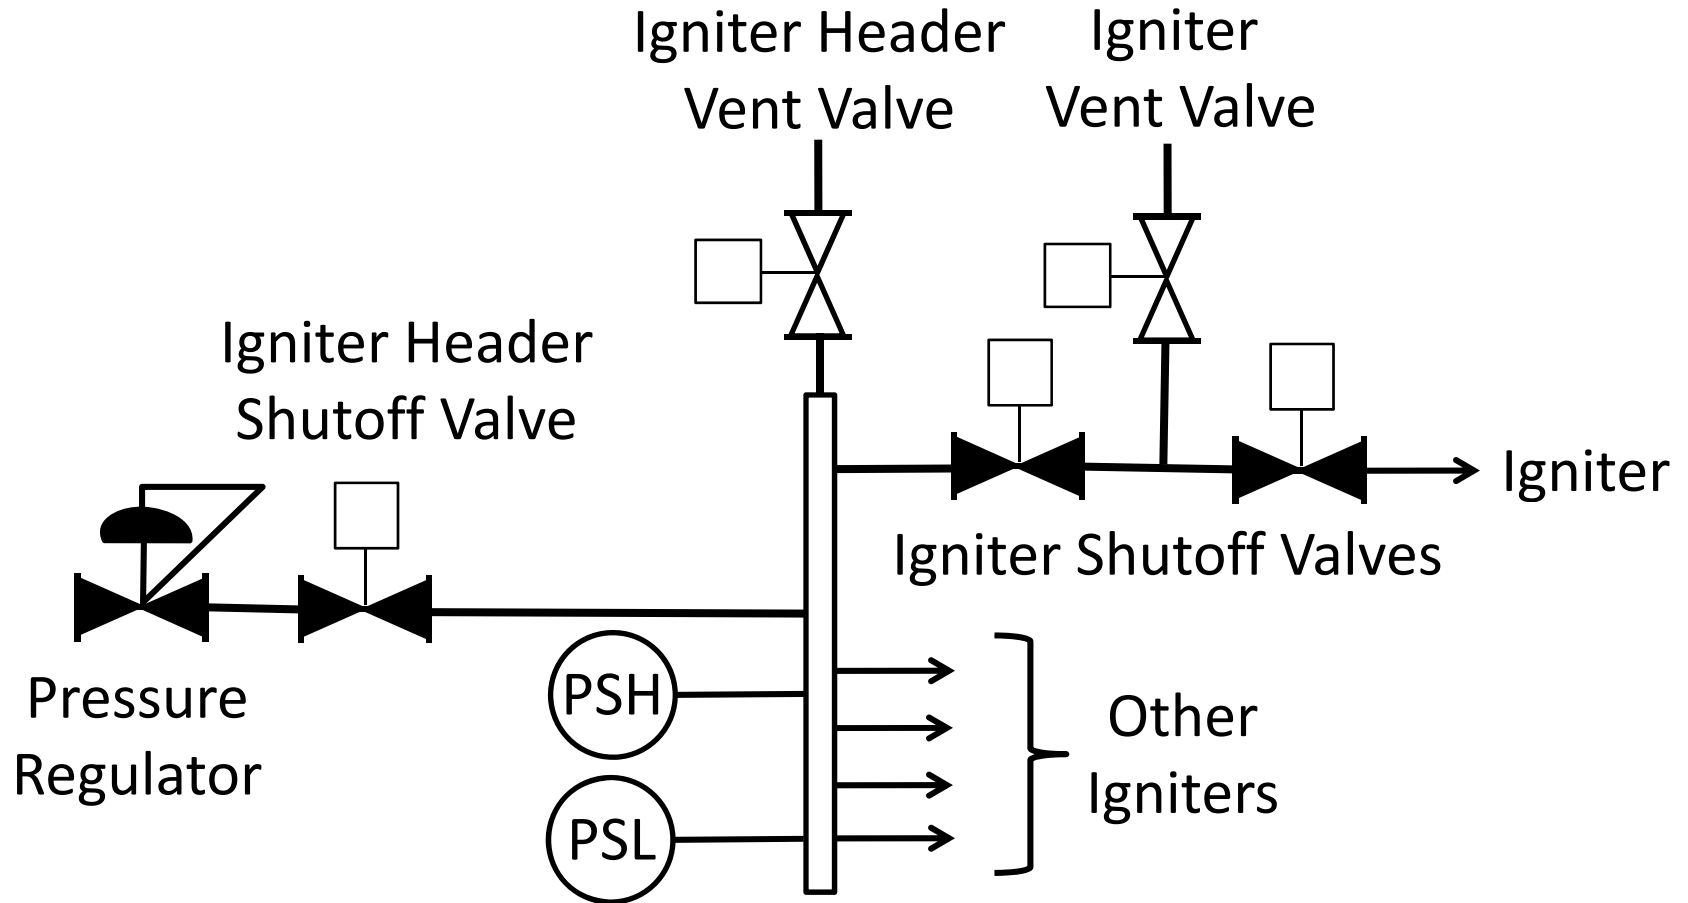


Leak Testing

- Chapter 6 of NFPA 85 describes the requirements for leak testing the gas supply system within the boiler house.
- These requirements include permanent provisions within the gas piping system for performing leak tests.
- Newer Burner Management systems include a leak test function within the start-up routines.

Burner Gas Header

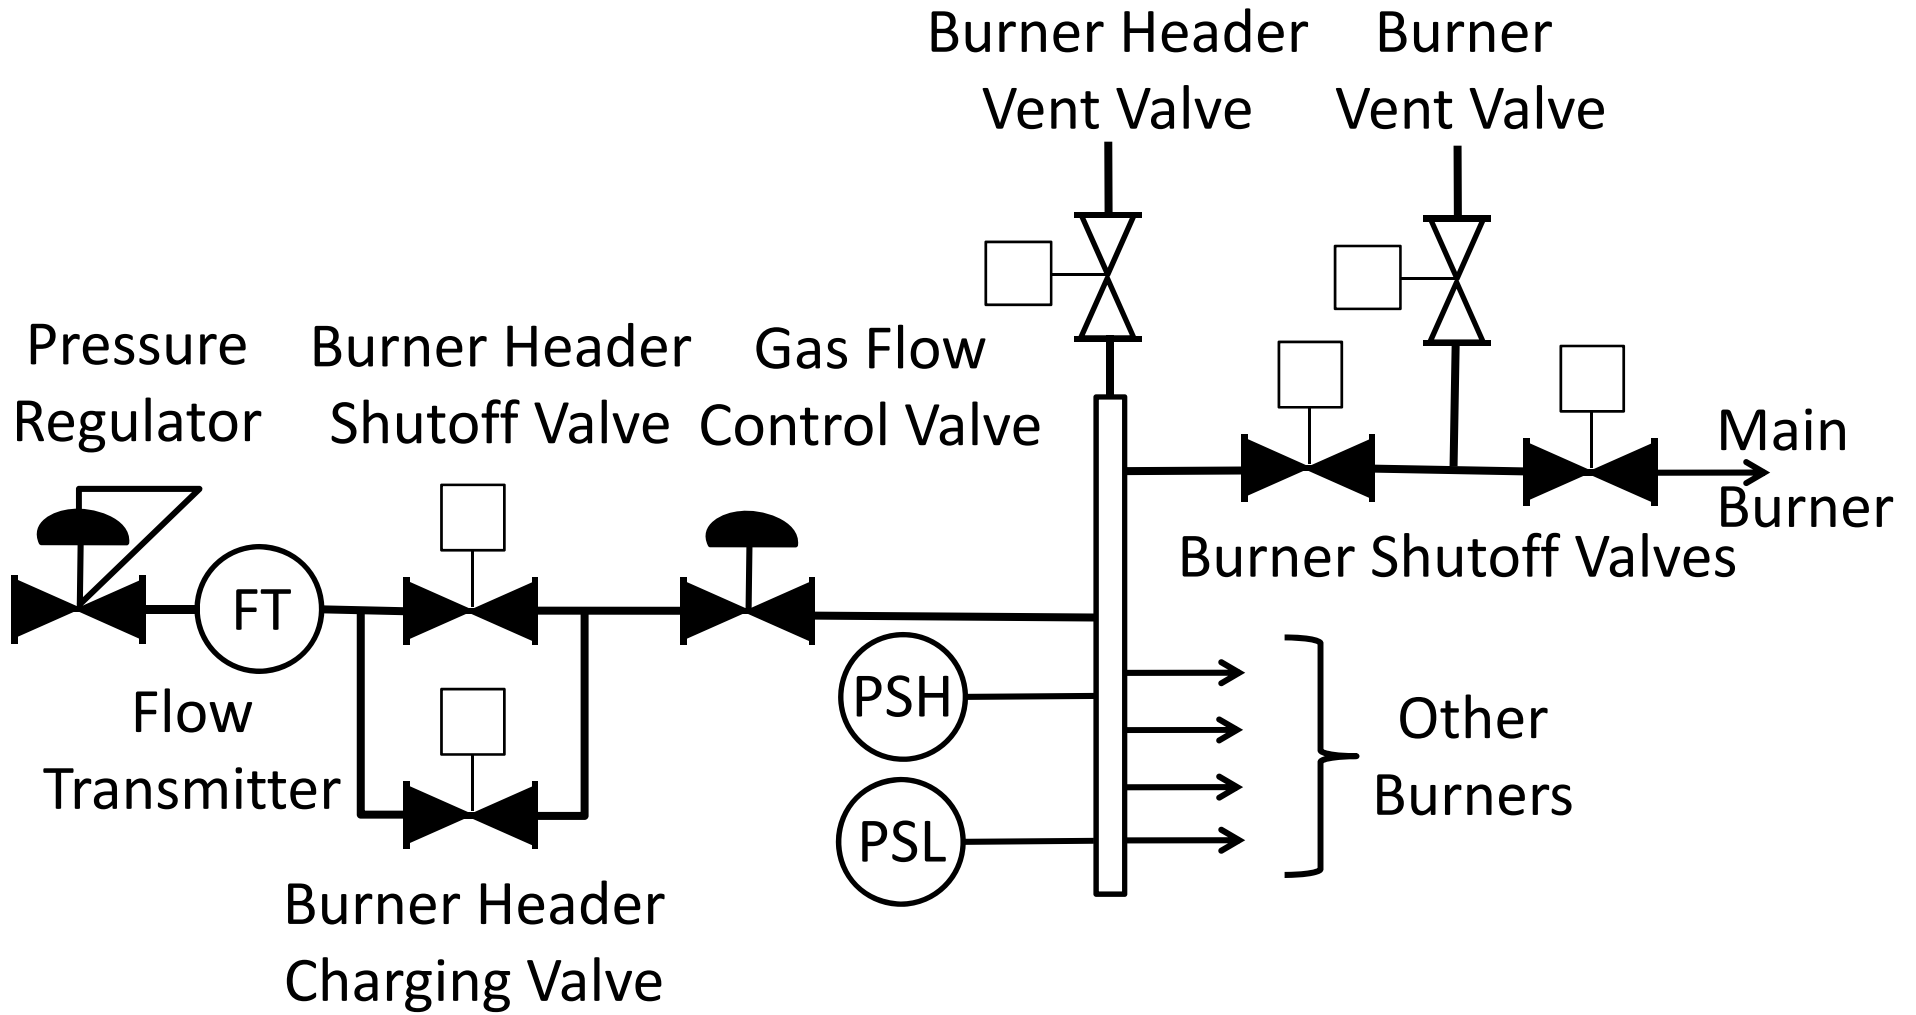

Venting

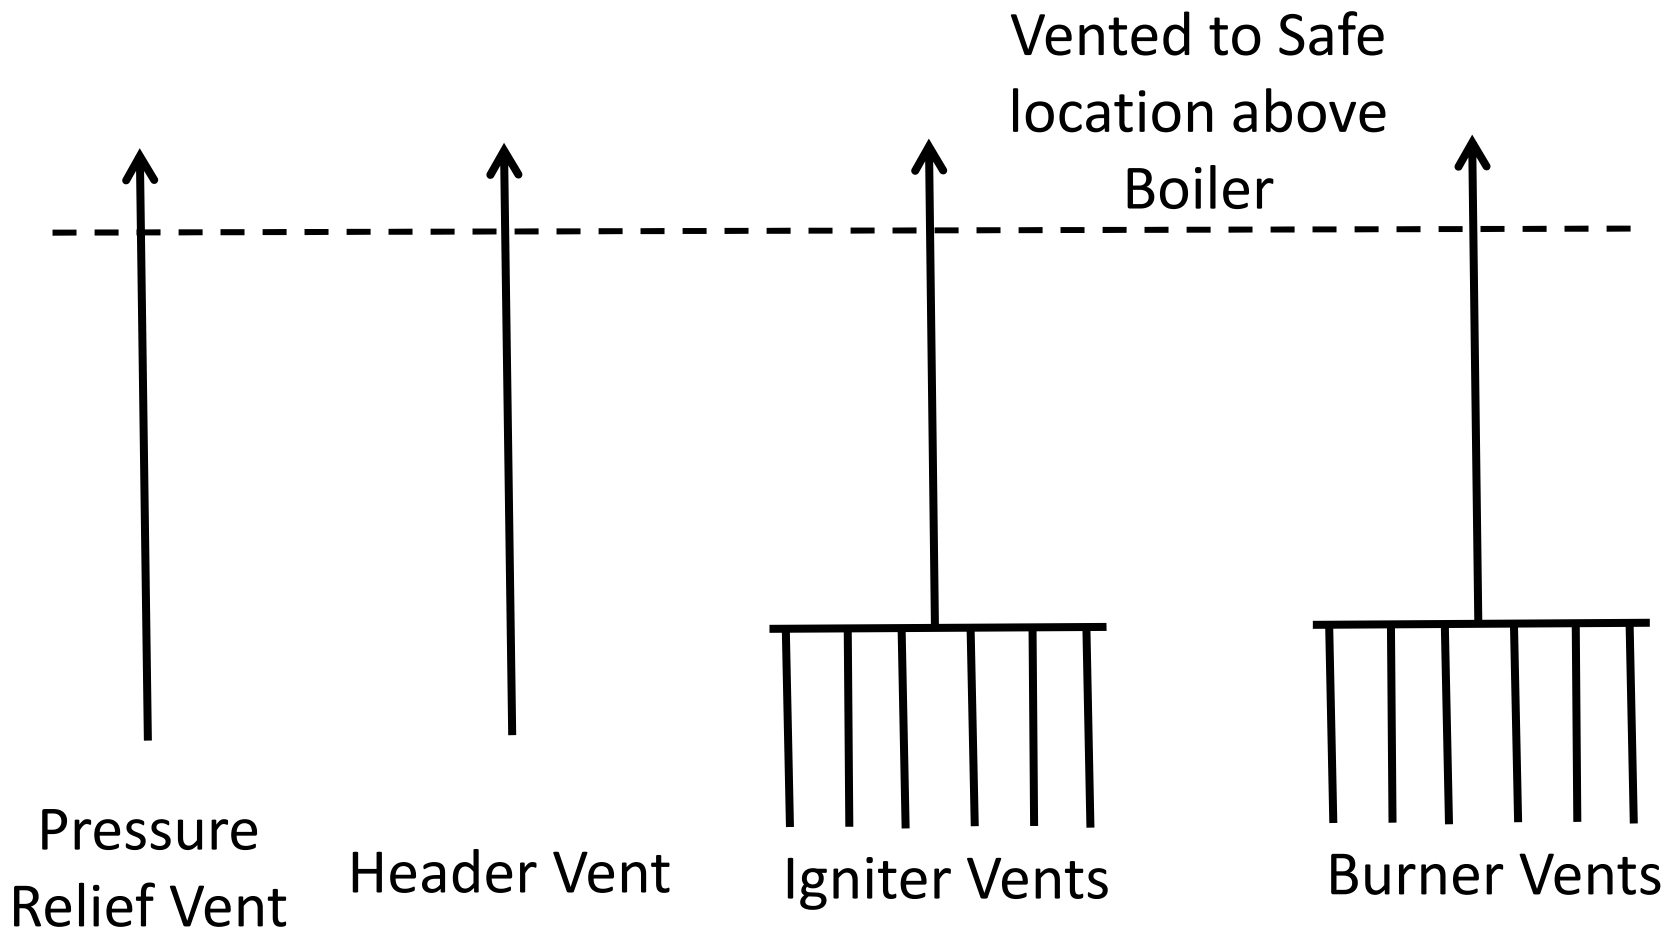

BMS Requirements

- ▶ No single component failure shall prevent a mandatory Master Fuel Trip (MFT)
- ▶ BMS logic system independent from any other logic system
- ▶ Logic protected from unauthorized changes
- ▶ Logic not to be changed on-line
- ▶ Proper operator intervention not to be prevented
- ▶ Trips require operator intervention to reset
- ▶ Signals from boiler control system permitted, but they must be hardwired if part of MFT

Master Fuel Trip (MFT)

Stop All fuel flow to furnace.

- ▶ Close all burner header safety shutoff valves
- ▶ Close igniter header safety shutoff valves
- ▶ Close individual igniter safety shutoff valves
- ▶ De-energize igniter sparks
- ▶ De-energize precipitators and other ignition sources

Flame Scanning - Gas

- Scanner types – Ultraviolet and Ionization
- Sighting to insure flame discrimination
- Gas Recirculation considerations

Flame Scanners – Gas Applications


Ultraviolet (UV)
Scanner Head




Ionization Detector



Gas Conversion Architecture

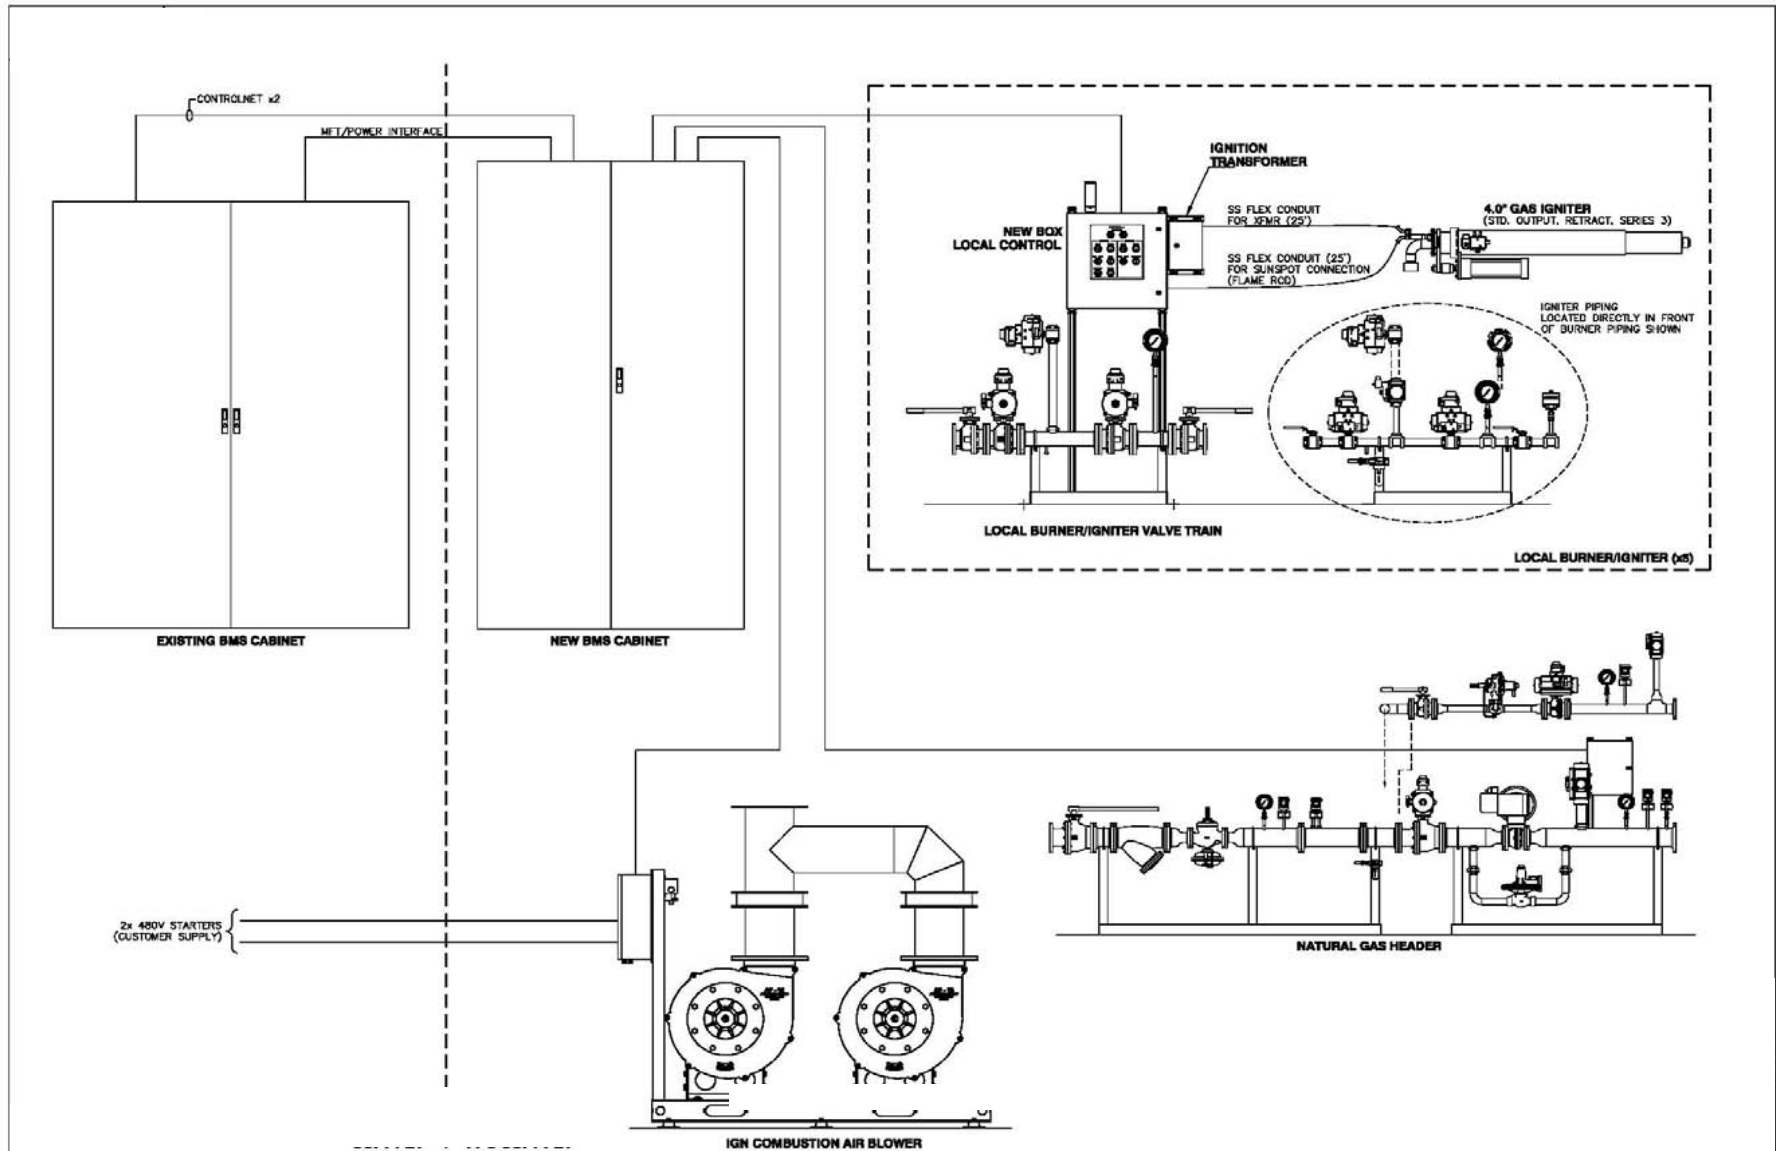

Burner Management System Graphics

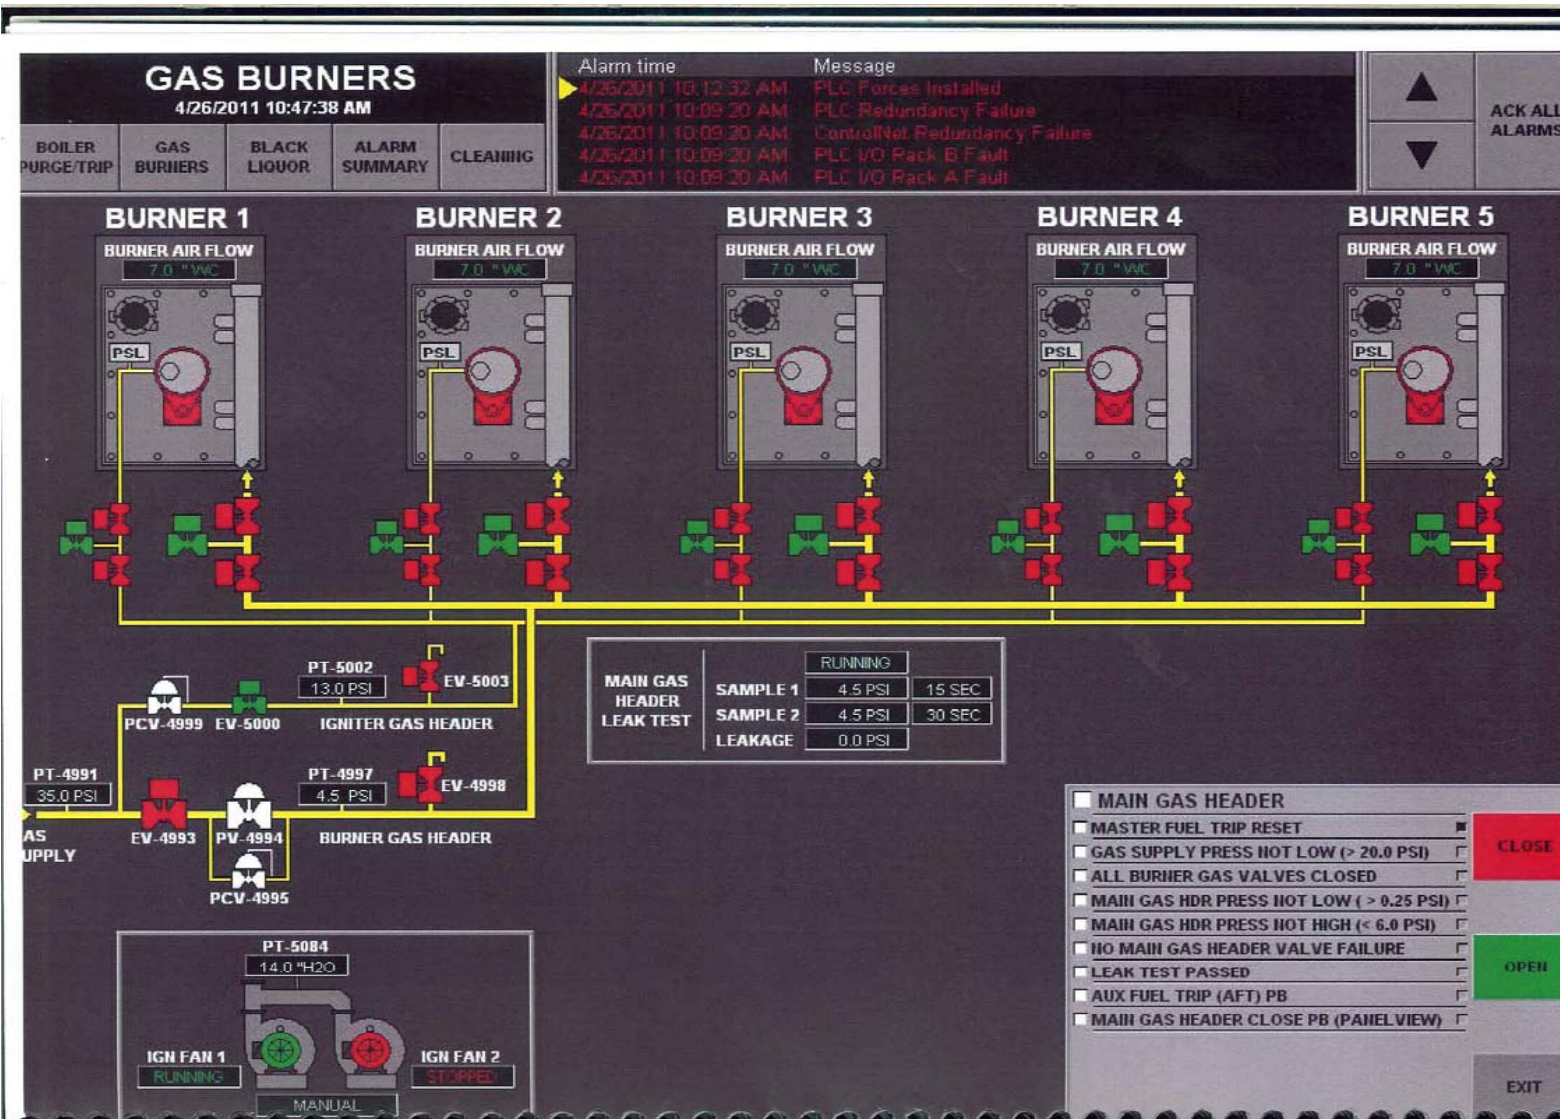

Typical Main Gas Valve Rack Assembly



Combustion Control

1. Existing control strategy is usually sufficient
2. Increase number of burners in service as load increases
3. When co-firing with coal burners, gas is fired through burners that are not firing coal. Separation of fuels via pulverizer groups
4. Maintain burner pressure within specified range

Combustion Control

5. Air flow should always lead fuel flow
6. Fuel to Air curves should be based on BTU values for Gas.
7. Cross limiting of fuel to air
8. Boiler outlet Oxygen used for air trim control

Area Classifications

- A gas conversion can be cause to review the Area Classification.
- NFPA 85 section 4.1.5 and A4.1.5 (Annex) references Hazardous Area Classifications.
- Addition of a Gas Supply to the boiler house does not automatically change the Area Classification to Hazardous.

Take Away Points

1. Main Gas Supply Pressure control and protection
2. Safety shut off valves to insure adequate isolation
3. Venting to a safe location
4. Maintain safe Air/fuel ratios

Questions ?

